

Axon™ Panel Timber Cavity Batten

Technical Specification
March 2024 New Zealand





We value your feedback!

To continue with the development of our products and systems, we value your input. Please send any suggestions, including your name, contact details, and relevant sketches to:

Ask James Hardie™
literaturefeedback@jameshardie.co.nz

Make sure your information is up to date

When specifying or installing Hardie™ fibre cement products, ensure that you have the current manual. Additional installation information, warranties and warnings are available at www.jameshardie.co.nz or **Ask James Hardie™** on **0800 808 868**.

**THIS TECHNICAL
SPECIFICATION
IS FOR
AXON™ PANEL
OVER TIMBER
CAVITY BATTEN.**

Contents

1	Product Information	4	7	Installation	17
1.1	Product Sizes and Accessories	4	7.1	Flexible Underlay or HomeRAB™ Pre-Cladding	17
1.2	Components and Accessories	6	7.2	RAB™ Board or a Rigid Air Barrier	17
1.2	Manufacturing and Classification	8	7.3	Vent Strip	17
			7.4	Cavity Battens	17
2	Application and Scope	8	7.5	Intermediate Support	18
2.1	Application	8	7.6	Flashings	18
2.2	Scope	8	7.7	Board and Batten Look	18
2.3	Limitations	9			
2.4	Details	9	8	Panel Fixing	18
			8.1	General	18
3	Compliance	9	8.2	Fastener Durability	19
3.1	Compliance	9	8.4	Panel Layout	21
			8.9	Jointing	21
4	Design	10	9	Finishing	22
4.1	Responsibility	10	9.1	Preparation	22
4.2	Surface Clearances	10	9.2	Coating	22
4.3	Structure	10	9.3	Sealants	22
4.4	Moisture Management	11			
4.5	Energy Efficiency	11	10	Care and Maintenance	23
4.6	Bracing	11			
4.7	Control of External Fire Spread	11	11	Details	24
4.8	Resistance to Moisture/Rotting	11			
4.9	Fire Rated Walls	12	Product Warranty	75	
4.10	Alpine Regions	12			
4.11	Tolerances	12			
4.12	Cavity Construction	12			
5	Safe Working Practices	13			
5.1	Storage and Delivery	15			
5.2	Tips for Safe and Easy Handling of Axon™ Panel	15			
6	Framing	16			
6.1	General	16			
6.2	Timber Framing	16			
6.3	Steel Framing	16			
6.4	Cavity Construction Method	16			
6.5	Special Framing Requirements	17			

1 Product Information

Grooved



Axon™ Panel 133mm Grooved

The grooves on the face panel are nominal 10mm wide x 2.25mm deep and spaced at 133mm centres.



Axon™ Panel 133mm Grooved Grained

The grooves on the face panel are nominal 10mm wide x 2.25mm deep and spaced at 133mm centres. Between the grooves is a look of traditional wood-grain texture.



Axon™ Panel 400mm Grooved

The grooves on the face panel are nominal 10mm wide x 2.25mm deep and spaced at 400mm centres.

Textured



Axon™ Panel Smooth

Formerly known as EasyLap™ Panel

Provides a durable, shiplap vertical joint panel appearance for residential/commercial building façades. The panel is finished with either a site applied roll on textured acrylic paint to create a rendered look with subtle vertical joint or a full mesh texture coating system.



Axon™ Brushed Concrete must be installed with the Hardie™ CLD™ Structural Cavity Batten. Refer to the Axon™ Panel Hardie™ CLD™ technical specification when installing the Axon Panel Brushed Concrete texture.


1.1 Product Sizes and Accessories


Table 1

Note: Axon™ Panel cladding is defined as a Light Weight Wall Cladding (not exceeding 30kg/m²) as per the NZS 3604.

Axon™ Panel Grooved					
Product	Description	Thickness (mm)	Size		Product Code
			Length (mm)	Width (mm)	
	Axon™ Panel 133mm Grooved Is a shiplap jointed panel to hide the panel joints. The panel is face primed. The panel has grooves at 133mm centres. The panel must be installed vertically. Nom. Panel Mass: 12.1kg/m ²	9	2450	1200	403780
			2750	1200	403781
			3000	1200	403782
			3600	1200	404979

Axon™ Panel Grooved					
Product	Description	Thickness (mm)	Size		Product Code
	<p>Axon™ Panel 133mm Grooved Grained</p> <p>Is a shiplap jointed panel to hide the panel joints. The panel is face primed. The panel has grooves at 133mm centres. The panel must be installed vertically.</p> <p>Nom. Panel Mass: 12.1kg/m²</p>	9	3000	1200	404979
	<p>Axon™ Panel 400mm Grooved</p> <p>Is a shiplap jointed panel to hide the panel joints. The panel is face primed. The panel has grooves at 400mm centres. The panel must be installed vertically.</p> <p>Nom. Panel Mass: 12.1kg/m²</p>	9	2450	1200	404414
			2750	1200	404415
			3000	1200	404416

Axon Panel Textured						
Product	Description	Thickness (mm)	Size		Product Code	
	<p>Axon™ Panel Smooth</p> <p><i>Formerly known as EasyLap™ Panel</i></p> <p>A shiplap edge panel for subtle vertical joints</p> <p>Nom. Panel Mass: 12.1kg/m²</p>	9	Length (mm)	Width (mm)	Product Code	
			2450	1200		404764
			3000	1200		404763

Hardie™ Axent™ Trim information						
Product	Description	Thickness (mm)	Size		Product Code	
	For box corners and facings	19	Length (mm)	Width (mm)	Product Code	
			3000	45		405260
			3000	70		405257
			3000	89		405258

Note: All dimensions and masses provided are approximate only and are subject to manufacturing tolerances.

1.2 Components and Accessories

Table 2










Accessories/tools supplied by James Hardie			
Accessories	Description	Quantity/Size (approx)	Code
	Hardie™ Aluminium Radius External Box Corner A box corner mould to form the external joints. 9mm etch primed.	2750mm long 3000mm long 4000mm long	306215 306216 306217
	Hardie™ Aluminium Invert External Box Corner A corner mould to form the invert external joints. 9mm etch primed.	2750mm long 4000mm long	306213 306214
	Hardie™ 9mm Panel Aluminium Horizontal 'h' Mould A horizontal flashing to flash the horizontal joints. 9mm etch primed.	3000mm long	304508
	Aluminium 'h' Mould Jointer A jointer to cover the butt joint of 'h' mould.	100mm long	304512
	Hardie™ 9mm Panel Aluminium h External Corner Jointer 'h' mould external corner		305940
	Hardie™ 9mm Aluminium Angle T Socket A horizontal T flashing to flash the horizontal joints. 9mm etch primed.	3000mm long	306210
	Hardie™ Angle T Horizontal Jointer A jointer to cover the butt joint of T mould	100mm long	306221
	Hardie™ Angle T External Corner Jointer T mould external corner		306222
	Hardie™ 9mm Aluminium Internal Corner to join two 9mm panels at an internal corner	2750mm long 4000mm long	306218 306219
	uPVC Vent Strip Used to provide protection from vermin entering cavity space.	3000mm long	302490
Tools			
	Hardie™ Blade Saw Blade Diamond tip 184mm diameter fibre cement circular saw blade. Spacers not included.	Each	300660
	Hardie™ Flex Stainless Steel 316 Nails For fixing panels through cavity battens. 60 x 3.15mm	5kg	302782
	Hardie™ Flex Hot Dip Galv. Nails For fixing panels through cavity battens. 60 x 3.15mm	5kg	302784




	Hardie™ Flex Stainless Steel 316 Nails For fixing panels through cavity battens. 75 x 3.15mm	5kg	304253
	Hardie™ Flex Hot Dip Galv. Nails For fixing panels through cavity battens. 75 x 3.15mm	5kg	304251

Table 3

Accessories/tools not supplied by James Hardie

James Hardie recommends the following products for use in conjunction with Axon™ Panel. James Hardie does not supply these products and does not provide a warranty for their use. Please contact component manufacturer for information on their warranties and further information on their products.

Accessories	Description
	Flexible Underlay To comply with Table 23 of E2/AS1.
	Flexible Tape A flexible self-adhesive tape used in preparation of a window. Refer to the Window installation section in this manual for more information. e.g. Super-Stick Building Tape® by Marshall Innovations or 3M™ All Weather Flashing Tape 8067 by 3M™ Marshall Innovations: 0800 776 9727 3M™: 0800 474 787
	200mm wide Polypropylene DPC Product used over flexible underlay at internal corners. ie. Super Course 500
	Joint Sealant Paintable flexible sealants are recommended for filling the joints. Refer to Section 7.2 for information. e.g. Sika® Sikaflex® MS, Sika® AT Facade, Bostik® Seal N Flex™-1 or similar
	Head Flashing Required over window heads to be supplied by window installer. Material must comply with Table 20 and 21 of E2/AS1.
	Flashing Material as per Table 20, 'E2/AS1'
	65 x 2.87mm RoundDrive Ring Shank Nail For fixing Axon™ Panel to the framing. Paslode®: (09) 477 3000
	Sika® Sikaflex® 11FC Sika®: 0800 SIKA NZ (0800 745 269)
	CRC® ADOS® Builders Fill Two part exterior grade fill to skim coat finish over brad nails.

	Dulux® Acrasand or Dulux® Sedona acrylic texture 0800 800 424
	Full mesh texture coating system e.g. STO®, or Resene® Construction Systems Texture coating system
	Stain Timbakote®, suitable for Axon™ Panel 133mm Grooved Grained Tel: 0800 846 225

1.2 Manufacturing and Classification

Axon™ Panel is a cellulose fibre reinforced cement building product. The basic composition is Portland cement, ground sand, cellulose fibre, water and proprietary additives. The panels are easily identified by the name 'Axon™ Panel' printed at regular intervals on the back face of panel.

Axon™ Panel is manufactured in Australia to the AS/NZS 2908.2 'Cellulose-Cement Products Part 2: Flat Sheets' (ISO 8336 'Fibre Cement Flat Panels') standards in New Zealand. James Hardie is an ISO 9001 certified manufacturer.

Axon™ Panel is classified Type A, Category 2 in accordance with AS/NZS 2908.2 "Cellulose-Cement Products".

For Safety Data Sheets (SDS) visit www.jameshardie.co.nz or Ask James Hardie on 0800 808 868.

2 Application and Scope

2.1 Application

Axon™ Panel installed as per this technical specification will meet the durability requirements for claddings as required under clause 'B2-Durability' of the NZBC.

Axon™ Panel are classified as lightweight wall claddings suitable for residential and light commercial buildings using timber framing. Axon™ Panel are pre-sealed on the face to take a suitable paint finish in any colour.

This document is intended for use by architects, designers and specifiers who may be involved with the specification of Axon™ Panel.

Axon™ Panel is classified as light weight wall cladding suitable for residential and light commercial buildings using timber framed buildings.

- Axon™ Panel is primed on the face to take a suitable paint finish in any colour.

For use of Axon™ Panel outside the published scope, the architect, designer or engineer must undertake specific design. For advice on designs outside the scope of this specification, Ask James Hardie™ on 0800 808 868.

2.2 Scope

The scope of this specification covers the use of Axon™ Panel fixed with timber cavity battens to buildings which fall within the scope limitations of 'Acceptable Solution E2/AS1 paragraph 1.1' of the New Zealand Building Code (NZBC) or the buildings covered by a specific engineering design (SED) up to design wind pressures of 2.5kPa (uls).

This document is intended for use by architects, designers and specifiers who may be involved with the specification of Axon™ Panel.

This specification covers the use of Axon™ Panel within the following scope:

- The Axon™ Panel must be installed vertically.
- An external wall structure that complies with the NZBC for an existing building or new building where the designer and/or installer has established that the external wall frame is suitable for this cladding installation.

Note: Refer to Axon™ Panel Direct Fix technical specification for direct fixed or Axon™ Panel Hardie™ CLD™ Structural Cavity Batten technical specification for the installation of Axon Panel/Axon Panel Brushed Concrete.

2.3 Limitations

- Axon™ Panel must not be used on curved wall applications
- Axon™ Panel must not be installed horizontally or angled
- The minimum ground clearances specified must be maintained
- Timber window joinery/recessed openings is subject to an alternative design by the designer
- Axon Panel must not be used for buildings over 10m height with timber cavity battens

2.4 Details

Various Axon™ Panel fixed to timber cavity batten figures are provided at the rear of this document. All dimensions shown are in millimetres unless noted otherwise. This specification and details in CAD file are also available for download at www.jameshardie.co.nz.

3 Compliance

3.1 Compliance

Axon™ Panel complies with E2 of the NZBC as an alternate solution.

Axon™ Panel claddings have been independently tested/assessed and meet the performance requirements of the NZBC. Axon™ Panel installed as per the details and information published in this technical specification are BRANZ Appraised. Refer to BRANZ Appraisal 1211(2022).



4 Design

4.1 Responsibility

The specifier or other party responsible for the project must run through a risk matrix analysis to determine which construction method is to be used. The designer must also ensure that the figures published in this specification are appropriate for the intended application and that additional detailing is performed for specific design or any areas that fall outside the scope of this specification. The designers should ensure that the intent of their design meets the requirements of NZBC.

All New Zealand Standards referenced in this manual are current edition and must be complied with.

Specifier

If you are a specifier or other responsible party for a project ensure that the information in this document is appropriate for the application you are planning and that you undertake specific design and detailing for areas which fall outside the scope of these specifications.

Installer

If you are an installer ensure that you follow the design, moisture management principles, and associated details and material selection provided by the designer. All details provided in this document must be read in conjunction with this specification.

Make sure your information is up to date

When specifying or installing Hardie™ fibre cement products, ensure you have the current manual. If you're not sure you do, or you need more information, visit www.jameshardie.co.nz or Ask James Hardie on 0800 808 868.

James Hardie conducts stringent quality checks to ensure that any product manufactured falls within our quality spectrum. It is the responsibility of the builder to ensure that the product meets aesthetic requirements before installation. James Hardie will not be responsible for rectifying obvious aesthetic surface variations following installation.

4.2 Surface Clearances

The clearance between the bottom edge of the cladding and paved/unpaved ground must comply with section 9.1.3 of E2/AS1. The finished floor level must also comply with these requirements. These clearances must be maintained throughout the life of the building .

Axon™ Panel must overhang the bottom plate on a concrete slab by a minimum of 50mm, as required by NZS 3604.

Axon™ Panel must have a minimum clearance of 100mm paved ground, and 175mm from unpaved ground.

On roofs and decks, the minimum clearance must be 50mm.

Do not install external cladding such that it may remain in contact with water or ground.

4.3 Structure

4.3.1 Timber Framing

Timber framed buildings must be designed in accordance with the NZS 3604 (Timber-framed buildings). When the framing is provided as per the specific engineering design, the framing stiffness must be equivalent to, or more than, the stiffness requirements of the NZS 3604.

For timber frame walls longer than 12m, it is best practice to allow for construction joints to accommodate movements generated due to timber shrinkage or deflections etc.

4.3.2 Wind Loading

Axon™ Panel is suitable for use in all wind zones in New Zealand up to and including EH as defined in the NZS 3604. A specific design is required for all situations where the buildings fall in a specific engineering design (SED) wind zone.

4.4 Moisture Management

It is the responsibility of the specifier to identify moisture related risks associated with any particular building design.

Wall construction design must effectively manage moisture, considering both the interior and exterior environments of the building, particularly in buildings that have a higher risk of wind driven rain penetration or that are artificially heated or cooled.

Walls must include those provisions as required by the NZBC Acceptable Solution E2/AS1 'External Moisture'. In addition all wall openings, penetrations, junctions, connections, window sills, heads and jambs must incorporate appropriate flashings for waterproofing. The other materials, components and installation methods used to manage moisture in external walls, must comply with the requirements of relevant standards, manufactures specifications and the NZBC.

4.5 Energy Efficiency

External walls constructed as per this technical specification, using Axon™ Panel cladding must use suitable bulk insulation to meet the minimum thermal insulation requirements as per Clause H1/AS1 'Energy Efficiency' of the NZBC.

4.6 Bracing

Axon™ Panel installed to timber cavity batten cannot be used to achieve structural bracing. However bracing can be achieved by using HomeRAB™ Pre-Cladding or RAB™ Board installed direct to framing instead of a flexible underlay or by using Villaboard™ Lining bracing system on the internal face. Refer to the Bracing Design Manual by James Hardie for further information.

4.7 Control of External Fire Spread

Axon™ Panel is suitable for use in external wall cladding applications where 'Non-Combustible Materials' are specified and complies with the requirements of Section 5.4 of C/AS1 and 5.8.1 (b) of C/AS2 of the NZBC.

Refer to Fire and Acoustic Design Manual by James Hardie for construction details.

4.8 Resistance to Moisture/Rotting

Axon™ Panel has demonstrated resistance to permanent moisture induced deterioration (rotting) and has passed the following tests in accordance with AS/NZS 2908.2:

- Heat Rain (Clause 6.5).
- Water Permeability (Clause 8.2.2).
- Warm Water (Clause 8.2.4).
- Soak Dry (Clause 8.2.5).

4.9 Fire Rated Walls

Axon™ Panel when fixed to timber cavity battens to external walls can achieve fire ratings up to 60/60/60 to comply with C/AS1 of the NZBC, when the walls are constructed in accordance with the current Fire and Acoustic Design Manual by James Hardie.

Axon™ Panel must be fixed at 150mm centres to the entire frame. Therefore top/bottom plate and nogs require suitable 150mm sloped cavity packers for the panel fixings.

Axon™ Panel are suitable for use where 'non-combustible' materials are required on walls close to a boundary.

4.10 Alpine Regions

In regions subject to freeze/thaw conditions, Axon™ Panel must not be in direct contact with snow or ice build up for extended periods, e.g. external walls in alpine regions must be protected where snow drifts over winter are expected.

The Axon™ Panel has been tested in accordance with AS/NZS 2908.2 Clause 8.2.3.

4.11 Tolerances

In order to achieve an acceptable wall finish, it is imperative that framing is straight and true.

Framing tolerances must comply with the requirements of the NZS 3604. All framing shall be made flush.

4.12 Cavity Construction

Buildings with a risk score of 7-20 calculated in accordance with Table 3 of Acceptable Solution E2/AS1 of the NZBC, require Axon™ Panel to be installed on a cavity. The battens provide airspace between the frame and the panel and are considered a “packer” only in this specification.

5 Safe Working Practices

WARNING - DO NOT BREATHE DUST AND CUT ONLY IN WELL VENTILATED AREA

Hardie™ fibre cement products contain sand, a source of respirable crystalline silica

May cause cancer if dust from product is inhaled. Causes damage to lungs and respiratory system through prolonged or repeated inhalation of dust from product.

Intact fibre cement products are not expected to result in any adverse toxic effects. The hazard associated with fibre cement arises from the respirable crystalline silica present in dust generated by activities such as cutting, rebating, drilling, routing, sawing, crushing, or otherwise abrading fibre cement, and when cleaning up, disposing of or moving dust.

When doing any of these activities in a manner that generates dust, follow James Hardie instructions and best practices to reduce or limit the release of dust.

If using a dust mask or respirator, use an AS/NZS 1716 P1 filter and refer to Australian/New Zealand Standard 1715:2009 Selection, Use and Maintenance of Respiratory Protective Equipment for more extensive guidance and more options for selecting respirators for workplaces. For further information, refer to our installation instructions and Safety Data Sheets available at www.jameshardie.co.nz.

FAILURE TO ADHERE TO OUR WARNINGS, SAFETY DATA SHEETS, AND INSTALLATION INSTRUCTIONS MAY LEAD TO SERIOUS PERSONAL INJURY OR DEATH.

Crystalline Silica is

- Commonly known as sand or quartz
- Found in many building products e.g. concrete, bricks, grout, wallboard, ceramic tiles, and all fibre cement materials

Why is Crystalline Silica a health hazard?

- Silica can be breathed deep into the lungs when present in the air as a very fine (respirable) dust
- Exposure to silica dust without taking the appropriate safety measures to minimise the amount being breathed in, can lead to a potentially fatal lung disease – silicosis – and has also been linked with other diseases including cancer. Some studies suggest that smoking may increase these risks
- The most hazardous dust is the dust you cannot see!

When is Crystalline Silica a health hazard?

- It's dangerous to health if safety protocols to control dust are not followed when cutting, drilling or rebating a product containing crystalline silica and when cleaning up
- Products containing silica are harmless if intact (e.g. an un-cut sheet of wall board)

Avoid breathing in crystalline silica dust

Safe working practices

- ✗ NEVER use a power saw indoors or in a poorly ventilated area
- ✗ NEVER dry sweep
- ✓ ALWAYS use M Class or higher vacuum or damp down dust before sweeping up
- ✗ NEVER use grinders
- ✓ ALWAYS use a dust reducing circular saw equipped with a sawblade specifically designed to minimise dust creation when cutting fibre cement – preferably a sawblade that carries the Hardie™ Blade name or one with at least equivalent performance – connected to an M Class or higher vacuum
- ✓ Before cutting warn others in the area to avoid dust
- ✓ ALWAYS follow tool manufacturers' safety recommendations
- ✓ ALWAYS expose only the minimum required depth of blade for the thickness of fibre cement to be cut
- ✓ ALWAYS wear a properly-fitted, approved dust mask or respirator P1 or higher in accordance with applicable government regulations and manufacturer instructions
- ✓ Consider rotating personnel across cutting tasks to further limit respirable silica exposures.


When cutting Axon™ Panels:

- ✓ Work outdoors only
- ✓ Make sure you work in a well ventilated area
- ✓ Position cutting station so wind will blow dust away from yourself and others in the working area
- ✓ Rotate employees across cutting task over duration of shift
- ✓ Cut products with a Hardie™ Blade Saw Blade (or equivalent) and a dust reducing circular saw connected to a M Class or higher vacuum
- ✓ When sawing, sanding, rebating, drilling or machining fibre cement products, always:
 - Wear your P1 or higher (correctly fitted in accordance with manufacturers' instructions), ask others to do the same.
 - Keep persons on site at least 2 metres and as far as practicable away from the cutting station while the saw is in operation
 - If you are not clean shaven, then use a powered air respirator with a loose fitting head top
 - Wear safety glasses
 - Wear hearing protection
- ✓ Make sure you clean up BUT never dry sweep. Always hose down with water/wet wipe or use an M Class or higher vacuum

Working Instructions

Hardie™ Blade Saw Blade

The Hardie™ Blade Saw Blade used with a dust-reducing saw is ideal for fast, clean cutting of Hardie™ fibre cement products. A dust-reducing saw uses a dust collector connected to a M Class or higher vacuum. When sawing, clamp a straight edge to the sheet as a guide and run the saw base plate along the straight edge when making the cut.

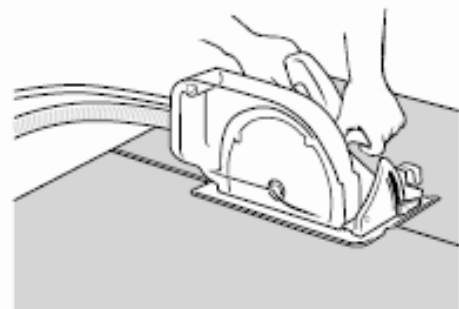


Hole-Forming

For smooth clean cut circular holes:

- Mark the centre of the hole on the sheet
- Pre-drill a 'pilot' hole
- Using the pilot hole as a guide, cut the hole to the appropriate diameter with a hole saw fitted to a heavy duty electric drill

For irregular holes:

- Small rectangular or circular holes can be cut by drilling a series of small holes around the perimeter of the hole then tapping out the waste piece from the sheet face
- Tap carefully to avoid damage to sheets, ensuring that the sheet edges are properly supported

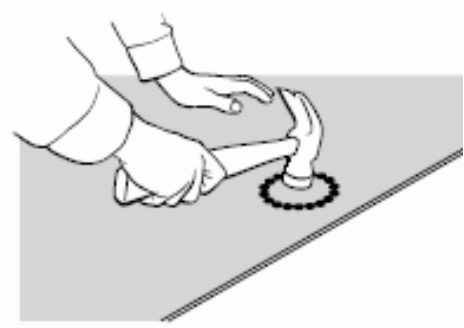

5.1 Storage and Delivery

Keeping products and people safe

Off loading

- ✓ Hardie™ fibre cement products should be off-loaded carefully by hand or by forklift
- ✓ Hardie™ fibre cement products should not be rolled or dumped off a truck during the delivery to the jobsite

Storage

Hardie™ fibre cement products should be stored:

- ✓ In their original packaging
- ✓ Under cover where possible or otherwise protected with a waterproof covering to keep products dry
- ✓ Off the ground – either on a pallet or adequately supported on timber or other spacers
- ✓ Flat so as to minimise bending

Hardie™ fibre cement products must not be stored:

- ✗ Directly on the ground
- ✗ In the open air exposed to the elements

James Hardie is not responsible for damage due to improper storage and handling.

5.2 Tips for Safe and Easy Handling of Axon™ Panel

- ✓ Carry with two people
- ✓ Hold near each end and on edge
- ✓ Exercise care when handling sheet products to avoid damaging the edges/corners

6 Framing

6.1 General

Axon™ Panels can be installed to timber-framed or steel-framed structures. Fixing to any other framing material is subject to a specific engineering design.

- Stud spacing must not exceed 600mm centres.
- Nog/dwang spacing must not exceed 800mm centres when studs are at 600mm centres.

6.2 Timber Framing

6.2.1 Dimensions

A 90 x 45mm minimum framing size is required.

A minimum 70mm wide stud is required at panel edges for cavity construction using Hardie™ Flex nails.

6.2.2 Structural Grade

Timber grade used must be in accordance with timber grades specified in NZS 3604.

6.2.3 Durability

The external framing must be treated to a minimum H1.2 treatment. Refer to NZBC Acceptable Solution B2/AS1 'Durability' for further information about the durability requirements.

For timber treatment and allowable moisture content information refer to NZS 3602 (Timber and Wood-Based Products for use in Buildings) and NZS 3640 (Chemical Preservation of Round Sawn Timber) for minimum timber treatment selection and treatment requirements.

Also refer to framing manufacturer's literature for further guidance on timber selection. Framing must be protected from moisture at site in accordance with the recommendation of framing manufacturer's.

Note: Refer to NZS 3602 for the allowable moisture contents in timber.

6.2.4 Frame Construction

The framing must fully support all panel edges. The framing must be rigid and not rely on the cladding panel for stability.

All timber framing sizes and set-out must comply with the NZS 3604 and as specified in this specification.

In case of gable end trusses sitting on top plates of the external wall frame, the frame size must be in accordance with truss design and specification supplied by the frame and truss manufacturer/supplier supported by independent design producer statement.

6.3 Steel Framing

Steel framing must either be in accordance with NASH 'Light Steel Framed Buildings' standard or as per SED.

6.4 Cavity Construction Method

For cavity construction method the following framing is required:

- When studs are spaced at 600mm centres maximum, the nogs/dwangs must be provided at 800mm centres maximum.

- A minimum 70mm wide or 2 x 90 x 45mm stud is required at vertical panel joint.
- When studs are spaced at 400mm centres then the nogs/dwangs may be provided at 1200mm centres.

6.5 Special Framing Requirements

The following are special framing requirements for both timber and steel framing:

- Double studs are required at internal corners, refer to Figure 8.
- Double studs are required at each shiplap vertical joint. Refer to Figures 6 and 7.

7 Installation

7.1 Flexible Underlay or HomeRAB™ Pre-Cladding

Flexible underlay must be provided as per the requirements of the NZBC Acceptable Solution E2/AS1 'External Moisture' Table 23. The flexible underlay must be fixed in accordance with E2/AS1 and the underlay manufacturer's recommendations. Walls which are not lined on the inside face (e.g. garage walls or gable ends) must include a rigid sheathing or an air barrier behind the cladding which complies with the requirements of the NZBC Acceptable Solution E2/AS1 Table 23. HomeRAB™ Pre-Cladding is suitable for use in these applications. It must be installed in accordance with HomeRAB™ Pre-Cladding and RAB™ Board installation manual.

7.2 RAB™ Board or a Rigid Air Barrier

In EH wind zone or for specific design wind zone and building height up to 10m, a rigid air barrier ie, RAB™ Board, must be used instead of flexible underlay. RAB™ Board is suitable to withstand wind pressures up to 4.5kPa.

To achieve the temporary weathertightness using HomeRAB™ Pre-Cladding or RAB™ Board, windows/doors can be temporarily installed. Refer to HomeRAB™ Pre-Cladding and RAB™ Board installation manual for information regarding its installation.

7.3 Vent Strip

The Hardie™ uPVC cavity vent strip must be installed at the bottom of all walls constructed using the drained and ventilated cavity construction method. It is important that the openings in the vent strip are kept clear and unobstructed to allow free drainage and ventilation of cavities. Hardie™ uPVC vent strip has an opening area of 1000mm²/m length.

7.4 Cavity Battens

The timber cavity battens must be minimum H3.1 treated in accordance with NZS 3640 (Chemical preservation of rough and sawn timber) to comply with the durability requirements of B2/AS1.

Cavity battens must comply with E2/AS1 and:

- Be minimum 18mm thick
- Be as wide as the width of studs

- Be provided at 300mm centres where studs are fixed at 600mm centres or alternatively refer to clause 4.5.
- Be fixed by the cladding fixings to the main framing over the flexible underlay. Therefore until claddings are fixed the battens only need to be fixed to framing by 40 x 2.8mm nails at 800mm centres.

7.5 Intermediate Support

Where studs are at 600mm centres an intermediate means of restraining the building underlay and insulation from bulging into the cavity shall be installed. An acceptable method to achieve this is using one of the following options:

- Intermediate cavity batten between the studs; or
- 75mm galvanized mesh; or
- Polypropylene tape at 300mm centres fixed horizontally and drawn taut

No intermediate supports/battens are required:

- When studs are spaced at 400mm centres; or
- When rigid air barriers instead of building underlays are used.

7.6 Flashings

All wall openings, penetrations, intersections, connections, window sills, heads and jambs must be flashed prior to panel installation. Please refer to moisture management requirements in Clause 2.5.

The flexible underlays must be appropriately incorporated with penetration and junction flashings. Materials must be lapped in such a way that water tracks down to the exterior on the face of flexible underlay.

The selected flashing materials must comply with the durability requirements of the NZBC. For information refer to Table 20 of E2/AS1.

7.7 Board and Batten Look

In order to achieve a board and batten look, Hardie™ Axent™ Trim can be fixed vertically over the panel surface.

The trims can be placed to suit the project's aesthetic requirements. However, we recommend a spacing of minimum 200mm centres is maintained between the trims.

Refer to Figures 11 - 15 for information.

8 Panel Fixing

8.1 General

Axon™ Panel must be kept dry and under cover whilst in storage or prior to/during the installation. Every endeavour must be made to keep framing dry once panel fixing commences. All site cut panel edges must be sealed prior to installation.

The shiplap jointing of panels is only suitable for vertical fixing of panels. Do not fix in the groove of Axon™ Panel. Minimum sheet width around window/door openings or corners etc. to be 200mm.

This specifications covers the fixing of Axon™ Panel to timber cavity battens fixed over timber frame. When fixing to a steel frame, Ask James Hardie 0800 808 868.

8.2 Fastener Durability

Fasteners must meet the minimum durability requirements of the NZBC. Refer to Table 1 for fixing materials requirements to be used in relation to the exposure conditions.

Table 4

Exposure conditions and nail selection prescribed by NZS 3604		
Zone	Application	
D (sea spray) and geothermal hot spots	General	Stainless steel 304/316
	Fire	
*C and B	General	Hot dip galvanised**
	Fire	

* Zone C areas where local knowledge dictates that increased durability is required, appropriate selection shall be made microclimatic conditions as detailed in NZS 3604, Paragraph 4.2.4 require SED.

**Hot dip galvanised must comply with AS/NZS 4680.

Also refer to the NZBC Acceptable Solution E2/AS1 Table 20 and 21 for information regarding the selection of suitable fixing materials and their compatibility with other materials.

8.3 Fastener – Size and Layout

Axon™ Panel must be fixed to framing using the fixings as specified in Table 2 below and follow the edge distance required for nails as shown in the details. Fixings must be finished flush with the panel surface. Refer to Figures 6 and 7.


Table 5

Panel fixing	
Cavity construction over flexible underlay	
60 x 3.15mm Hardie™ Flex nails.	Fix at 200mm centres to all vertical framing. Stud width 70mm min required at vertical joint.
Cavity construction over HomeRAB™ Pre-Cladding or RAB™ Board	
75 x 3.15mm Hardie™ Flex nails.	Fix at 200mm centres to all vertical framing. Stud width 70mm min required at vertical joint.

For other fixing options Ask James Hardie on 0800 808 868.

- Special fixing arrangements are required for fire-resistance rated wall systems. Fixings are 150 around the perimeter and to nogs and studs, therefore small battens are required on nogs and plates. For more information Ask James Hardie on 0800 808 868.
- When studs spaced at 400mm centres using Axon™ Panel 400mm Grooved, the nail fixings to intermediate studs to be offset 5mm from the groove in Panel.
- When fixing the panels using nail guns, refer to the nail gun manufacturer for information about nails and the type of nail gun to be used.

Note: Do not use 'D' head nails.

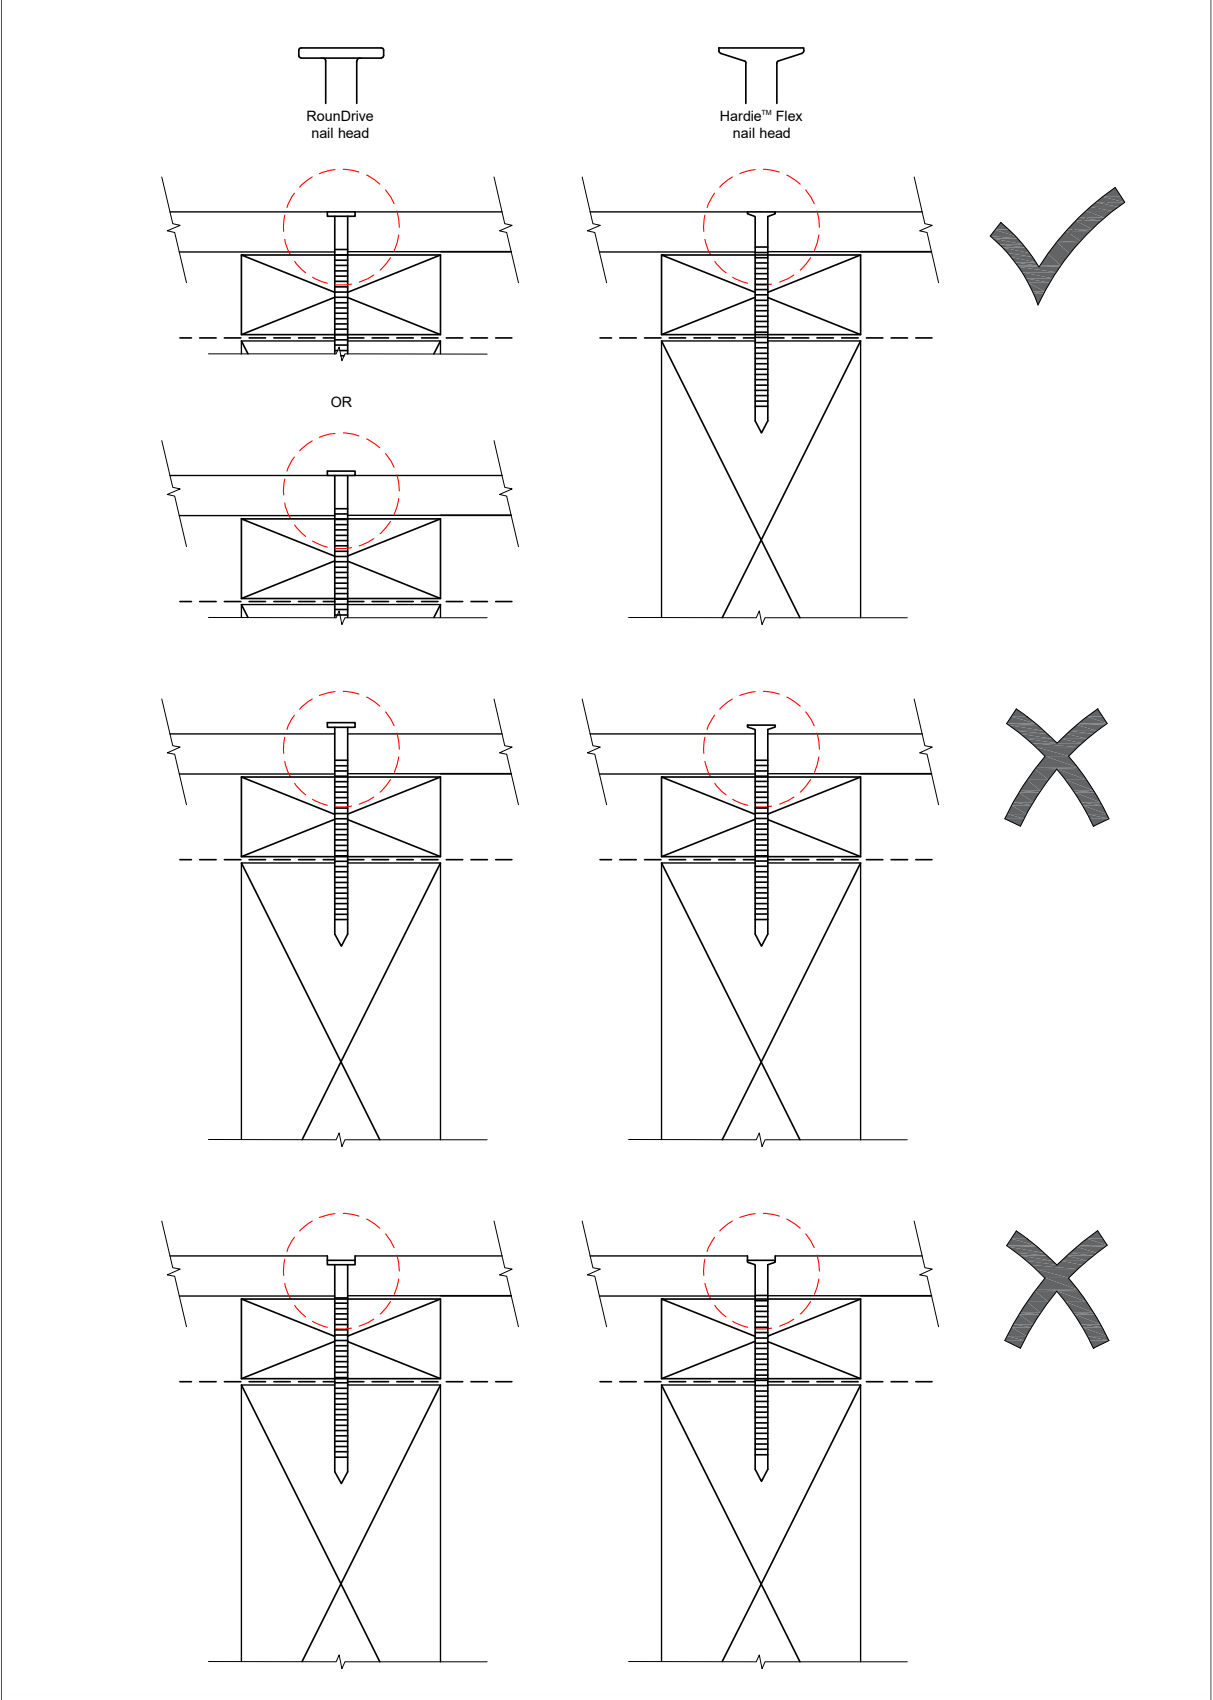

8.4 Panel Layout

All panel edges must be supported by the framing. The shiplap joint must be formed vertically. The framing centres must be checked before the panel installation. Refer to Figure 3.

8.9 Jointing

Axon™ Panels are fixed to form a shiplap joint at vertical edges. The panels have factory made edges to suit this jointing.

8.9.1 Vertical Joint

Axon™ Panels are shiplap jointed keeping a gap of 1-2mm between the panels. A 50mm wide 3259 Inseal sealing tape is used under the joint. A flexible sealant must be applied to the full length of the joint before the panels are jointed. The edge distance for a Hardie™ Flex nail must be 18mm min. Refer to Figures 6 and 7.

8.9.2 Horizontal Joint

At floor joist levels a horizontal joint must be provided to accommodate the movement resulting from timber joist shrinkage and settlement. A Hardie™ 9mm aluminium horizontal 'h' mould or a Hardie™ 9mm aluminium angle 't' socket is used to form a horizontal joint. Use the respective aluminium 'h' mould jointer or 't' socket jointer to cover over the butt joint of flashings. A purpose made metal 'Z' flashing could also be used to flash the horizontal joint. Refer to Figure 43.

8.9.3 External Corner

An aluminium radius or invert box corner flashing is used to form the external box corner. The site cut sheet edges are sealed before butting them into the box corner.

On a two storey construction the aluminium box corner is finished under the aluminium 'h' mould. A Hardie™ 9mm aluminium 'h' mould external corner must be used over the corner when in this situation. Refer to Figures 9 and 30.

8.9.4 Internal Corner

The internal corner is formed using the Hardie™ 9mm aluminium internal corner behind the panel. Refer to Figure 8.

8.9.5 Flashing Material Durability

Please refer to Table 20 of E2/AS1 of the NZBC regarding the durability requirements of various flashing materials.

9 Finishing

9.1 Preparation

Painting of Axon™ Panel is mandatory to meet the durability requirements of the NZBC and 15 year James Hardie product warranties. Axon™ Panel must be dry and free of any dust or grime before painting. The panels must be painted within 90 days of their installation. There is no restriction on the LRV of paint to be applied on the Axon™ Panel.

Dark paints can be used when using the aluminium flashings.

Panels are pre-primed and are suitable for site applied acrylic paints. Pre-finished panels can also be installed using exposed head fasteners.

In order to seal cut edges or sanded patches, Dulux® 1 Step, Resene® quick dry, Taubmans® Underproof Acrylic Primer Undercoat or a similar product should be applied. The primer should be compatible with the paint to be used.

For best aesthetic results a low sheen paint is recommended.

9.2 Coating

9.3.1 Paint

Axon™ Panel are supplied pre-primed. Panels must be painted within 90 days of installation. Use only quality exterior paints complying with AS 3730. Manufacturer's specification for the selected paint must be followed.

9.2.1 Staining - Only for Axon™ Panel 133mm Grooved Grained

Stains containing linseed oil are specifically designed for wood and may not be suitable for fibre cement cladding products, primed or unprimed. Semi-transparent stains can vary in uniformity of appearance depending on method of application and conditions, requiring a high level of skill and craftsmanship to achieve a uniform appearance. Clear coats have not proven durable in exterior exposure and James Hardie considers them a maintenance item that may require application of a refurbishing sealer at regular intervals. James Hardie does not warrant the appearance and durability of the use of semi-transparent stains and clear coats.

For further information contact the stain manufacturers. Refer to Section 13 for stain manufacturer details.

9.2.3 Roll on Texture - Only for Axon™ Panel Smooth

Axon™ Panel Smooth can be finished with rolled on texture acrylic texture coatings. Panels are supplied pre-primed and are ready for acrylic textures to be applied directly to it. Acrylic texture products are available in a range of textures that vary from fine finish to rough texture for a fast application on site. Refer to Dulux® or other similar texture coating suppliers for further information.

9.3 Sealants

All sealants used must comply with the relevant requirements of the NZBC. The application and usage must be in accordance with manufacturer's instructions. Check with sealant manufacturer prior to coating over sealants. Some sealant manufacturers do not recommend coating over their product.

10 Care and Maintenance

The extent and nature of maintenance will depend on the geographical location and exposure of the building. As a guide, it is recommended that basic normal maintenance tasks shall include but not be limited to:

- Washing down exterior surfaces every 6-12 months using low pressure water and a brush, and every 3-4 months in extreme coastal conditions or sea spray zones. Refer to your paint manufacturer for wash down requirements and do not use a water blaster to wash down the cladding.
- Re-applying of exterior protective finishes if necessary. Always refer to your paint manufacturer for re-coating requirements.
- Maintaining the exterior envelope and connections including joints, penetrations, flashings and sealants that may provide a means of moisture entry beyond the exterior cladding.
- Cleaning out gutters, blocked pipes and overflows as required
- Pruning back vegetation that is close to or touching the building
- The clearance between the bottom edge of Axon™ Panel and the finished ground must always be maintained.

11 Details

The following generic details have been provided in this document for cavity construction methods.

Table 6

Panel fixing	
Description	Page
Figure 1: Cavity fixed typical framing setout	26
Figure 2: Cavity batten fixing setout	27
Figure 3: Cavity fixed typical panel fixing setout	28
Figure 4: Cavity fixed foundation detail	29
Figure 5: Cavity fixed enclosed deck detail	30
Figure 6: Axon™ Panel cavity shiplap joint	31
Figure 7: Axon™ Panel cavity shiplap joint	31
Figure 8: Cavity internal corner detail	32
Figure 9: Cavity external corner	33
Figure 10: Hardie™ Axent™ Trim™ at internal corner	33
Figure 11: Axent™ Trim™ at external corner	34
Figure 12: Hardie™ Axent™ Trim to Axon™ Panel at joint	35
Figure 13: Hardie™ Axent™ Trim to Axon™ Panel at non joint	36
Figure 14: Hardie™ Axent™ Trim to Axon™ Panel at non joint	37
Figure 15: Hardie™ Axent™ Trim fixing	38
Figure 16: Vertical sealant joint	39
Figure 17: Soffit detail	40
Figure 18: Nil soffit detail	41
Figure 19: Window head	42
Figure 20: Window sill	43
Figure 21: Window jamb	44
Figure 22: Window jamb with scribe	45
Figure 23: Cavity alternative head flashing termination against batten	46
Figure 24: Window head with facing	47
Figure 25: Window sill with planted sill	48
Figure 26: Window and door jamb with facing	49
Figure 27: Cavity horizontal joint detail	50
Figure 28: Horizontal joint in tall wall	51
Figure 29: Cavity aluminium 'H' mould jointer	52
Figure 30: Cavity corner at 'H' mould joint detail	53
Figure 31: Internal corner at 'H' mould joint detail	54
Figure 32: Angle 'T' socket joint at floor joist	55
Figure 33: Horizontal joint in tall wall	56
Figure 34: Angle 'T' horizontal jointer	57
Figure 35: Angle 'T' external corner at 'T' mould joint	58

Figure 36: Internal corner at angle 'T' socket joint detail	59
Figure 37: Joining moulding	60
Figure 38: Cavity pipe penetration	61
Figure 39: h' mould joint at window head	62
Figure 40: Angle 'T' socket at window head	63
Figure 41: Horizontal flashing at window jamb	64
Figure 42: Angle 'T' socket butting window jamb	65
Figure 43: Drained flashing joint at floor joist	66
Figure 44: One piece apron flashing joint	67
Figure 45: Enclosed deck balustrade to wall junction aluminium internal corner	68
Figure 46: Enclosed deck balustrade to wall junction	69
Figure 47: Parapet flashing	70
Figure 48: Garage jamb	71
Figure 49: Garage head	72
Figure 50: junction between panel and fascia board	73
Figure 51: Enclosed roof to wall intersection	74

Figure 1: Cavity fixed typical framing setout


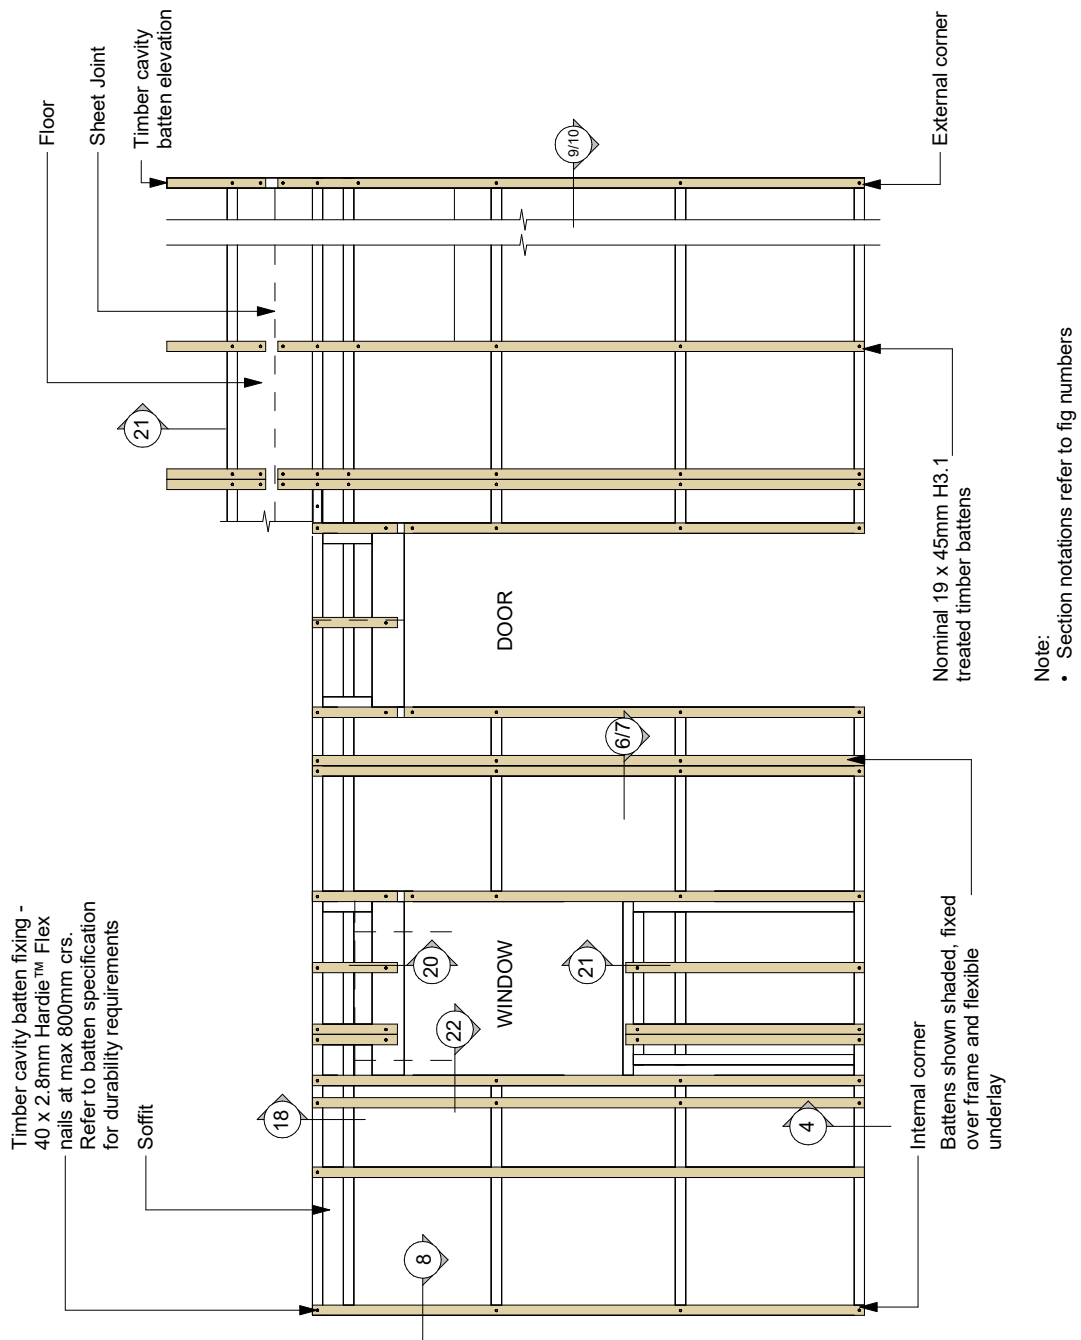



Figure 2: Cavity batten fixing setout

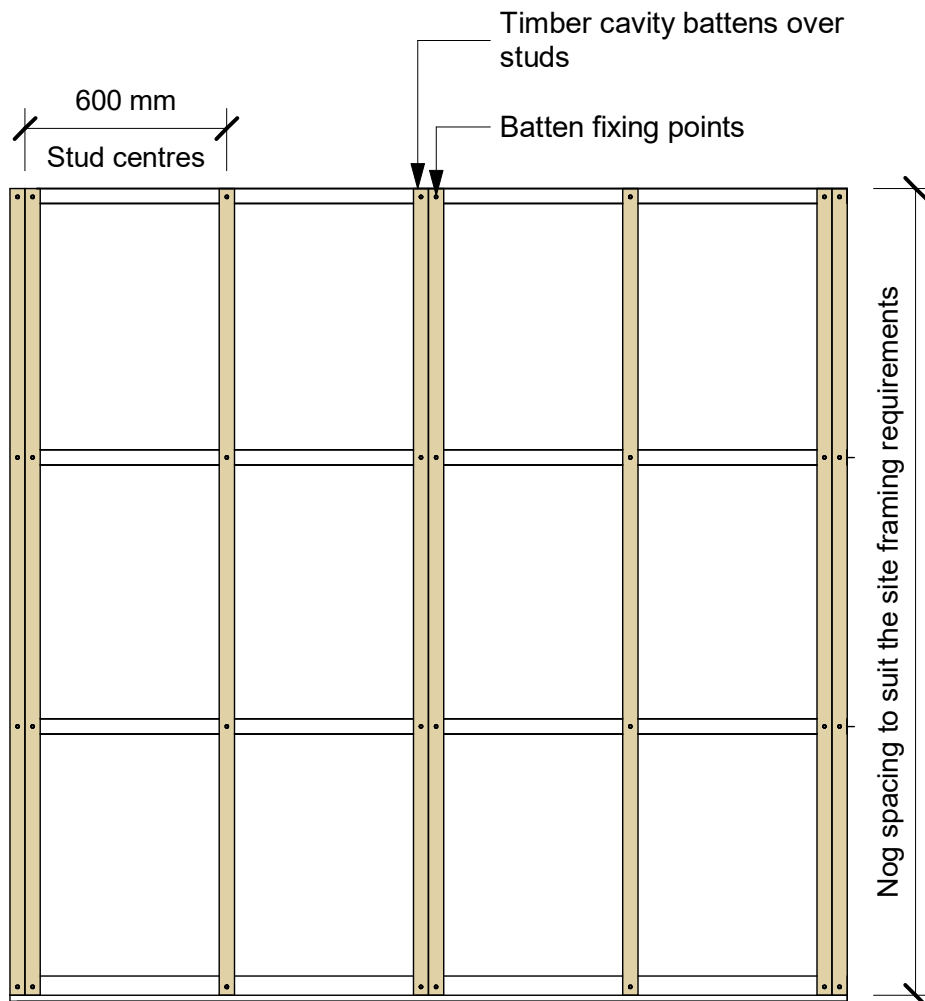

Note:

- Check Figure 6 and 7 for framing and batten requirements for vertical joint
- For fire rated wall systems by James Hardie nog spacing must be 800mm centres maximum
- For fire resistance rated wall systems, Axon™ Panel must be fixed at 150mm centres to the entire frame. Therefore top/bottom plate and nogs require suitable 150mm sloped cavity packers for the panel fixings


Figure 3: Cavity fixed typical panel fixing setout

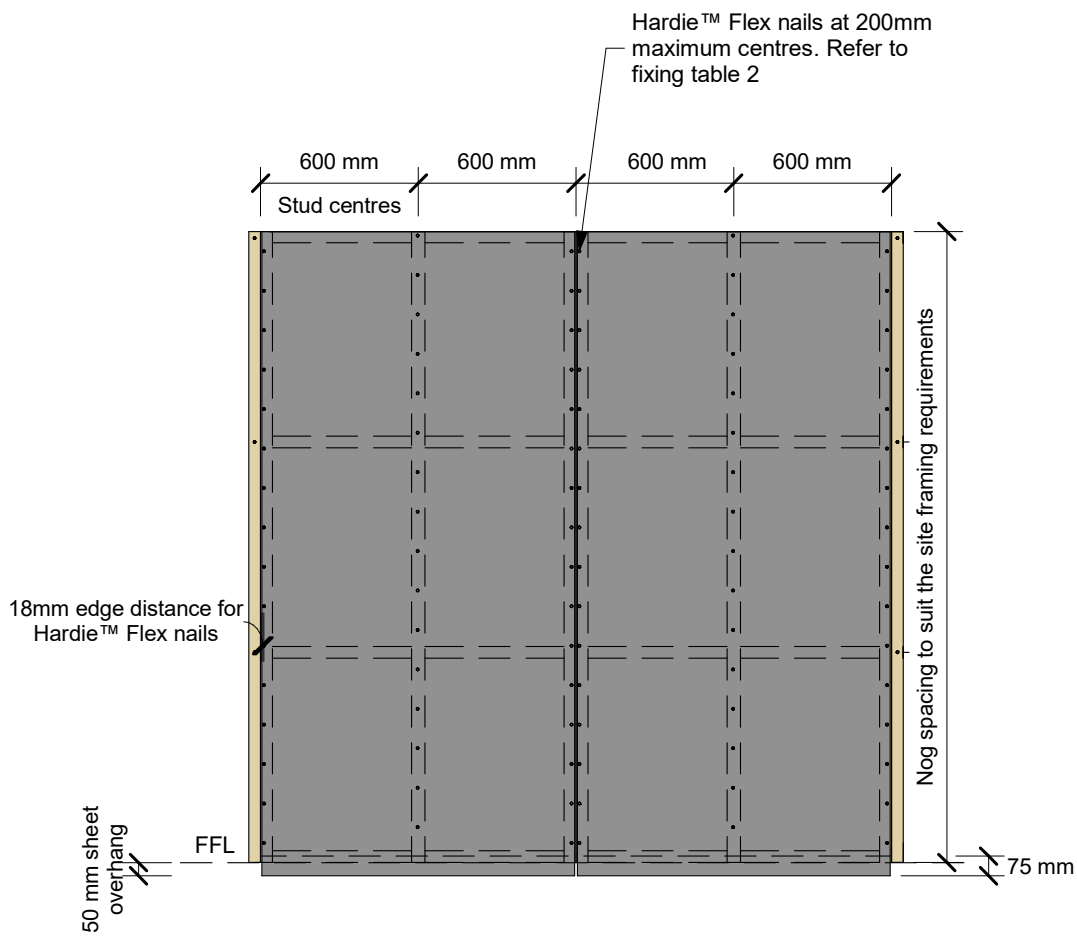

Note:


- When studs spaced at 400mm centres using Axon™ Panel Grooved 400, the nail fixings to intermediate studs to be offset 5mm from the groove in Panel.
- For fire rated wall systems by James Hardie nog spacing must be 800mm centres maximum
- For fire resistance rated wall systems, Axon™ Panel must be fixed at 150mm centres to the entire frame. Therefore top/bottom plate and nogs require suitable 150mm sloped cavity packers for the panel fixings

Figure 4: Cavity fixed foundation detail

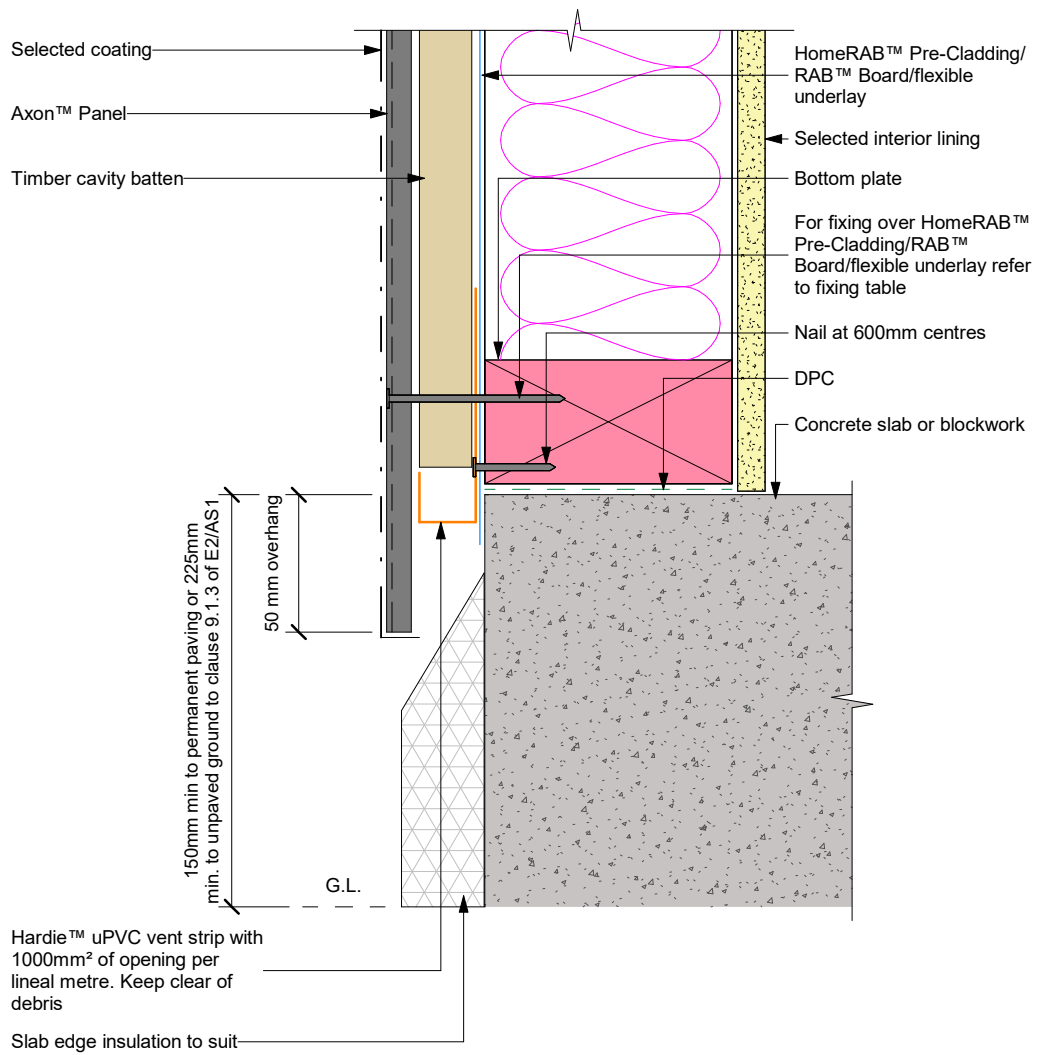

- Note:
- Site cut edges to be primed
 - For uninsulated slab refer to jameshardie.co.nz
 - Refer to section Surface Clearances for further information

Figure 5: Cavity fixed enclosed deck detail

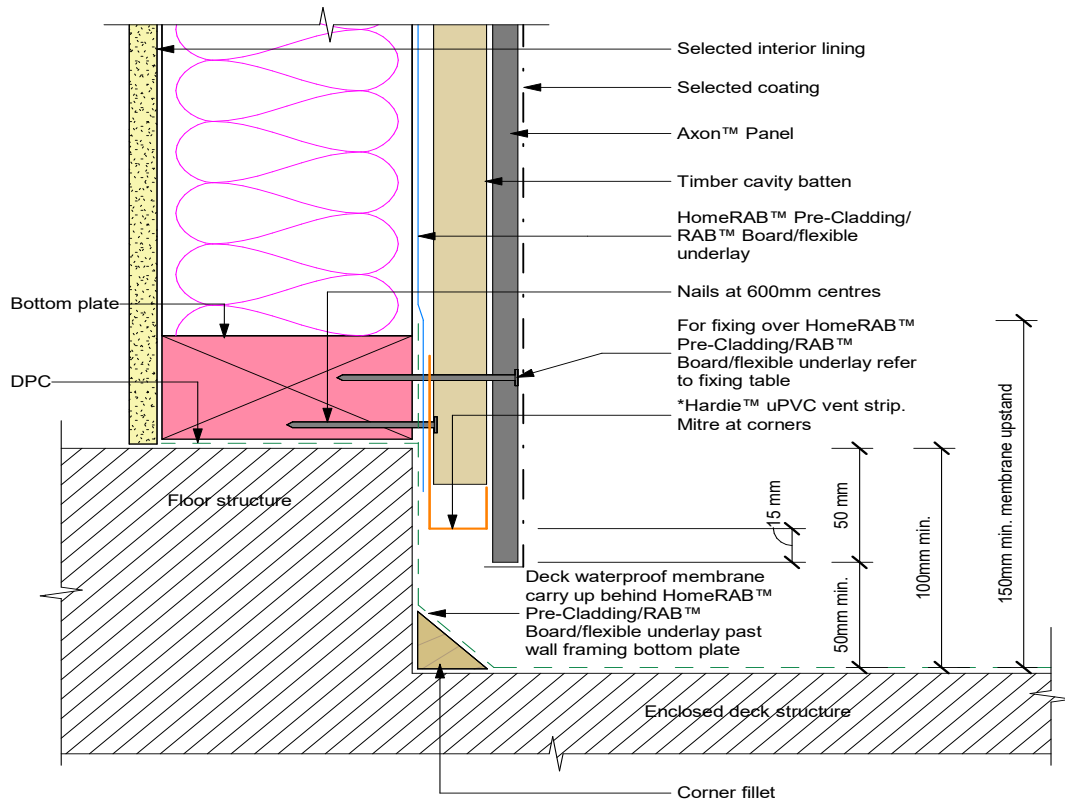

*Drain holes in Hardie™ uPVC vent strip to achieve the required ventilation openings of 1000mm² per lineal metre

Figure 6: Axon™ Panel cavity shiplap joint

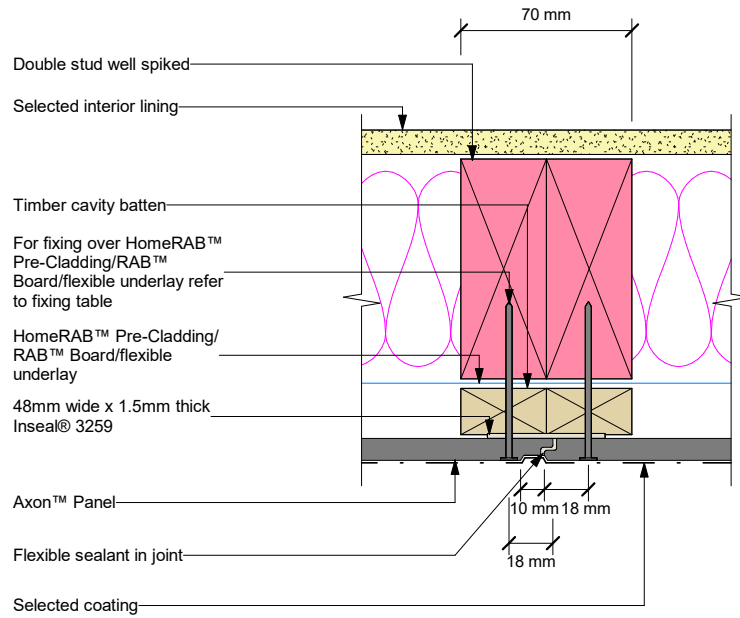


Figure 7: Axon™ Panel cavity shiplap joint

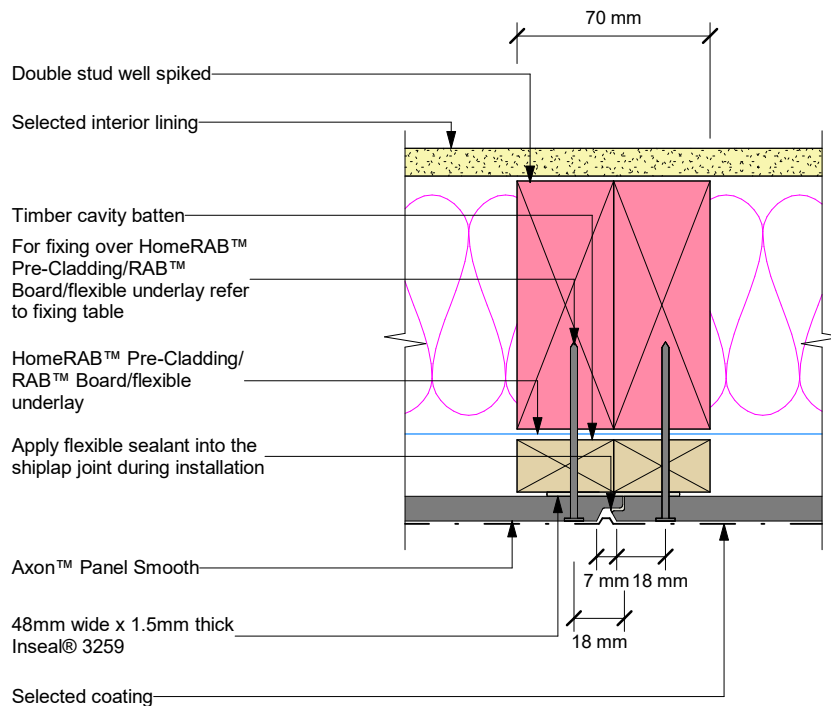


Figure 8: Cavity internal corner detail


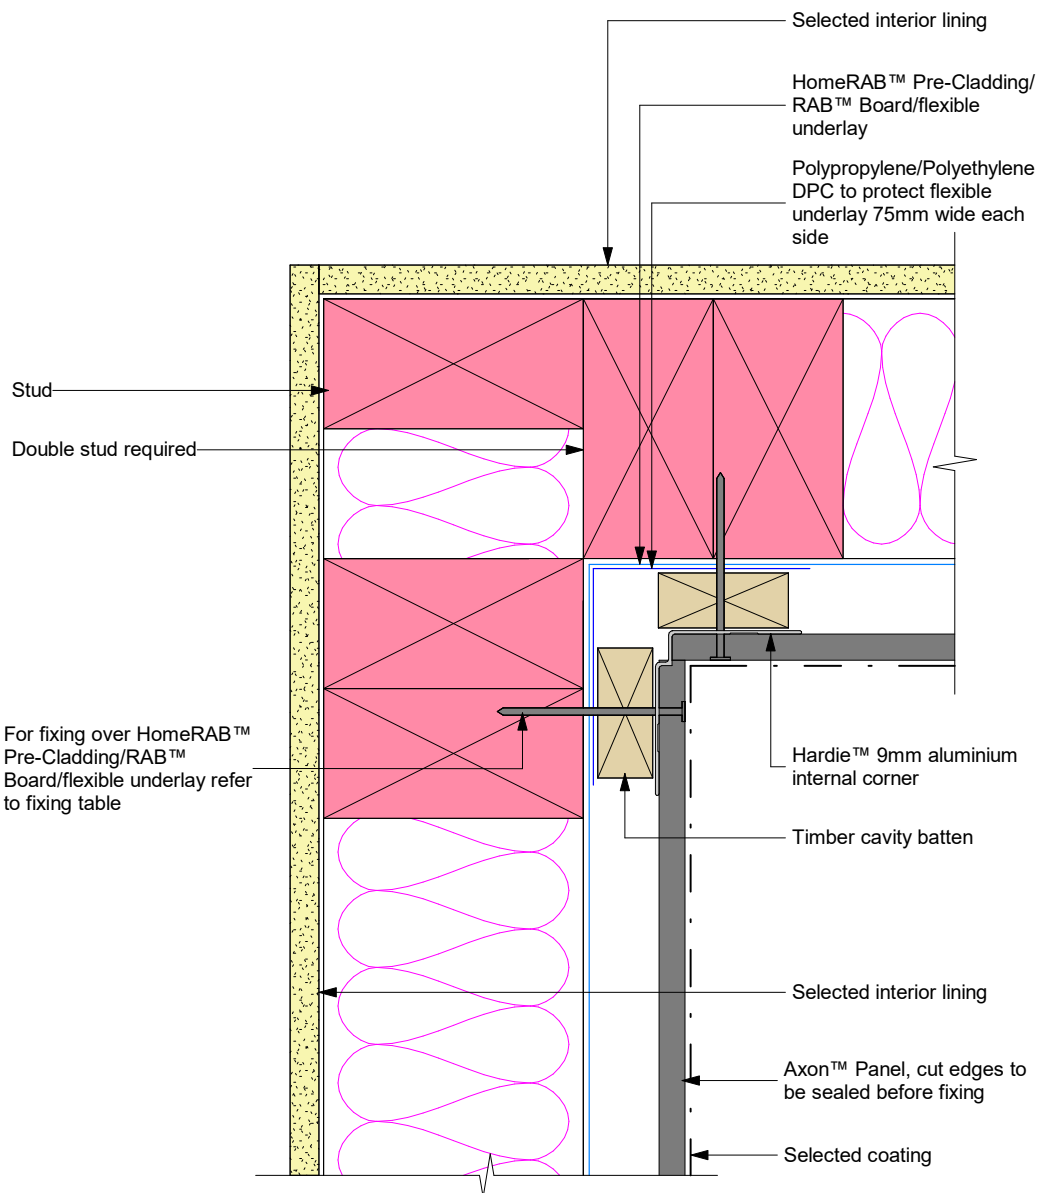


Figure 9: Cavity external corner

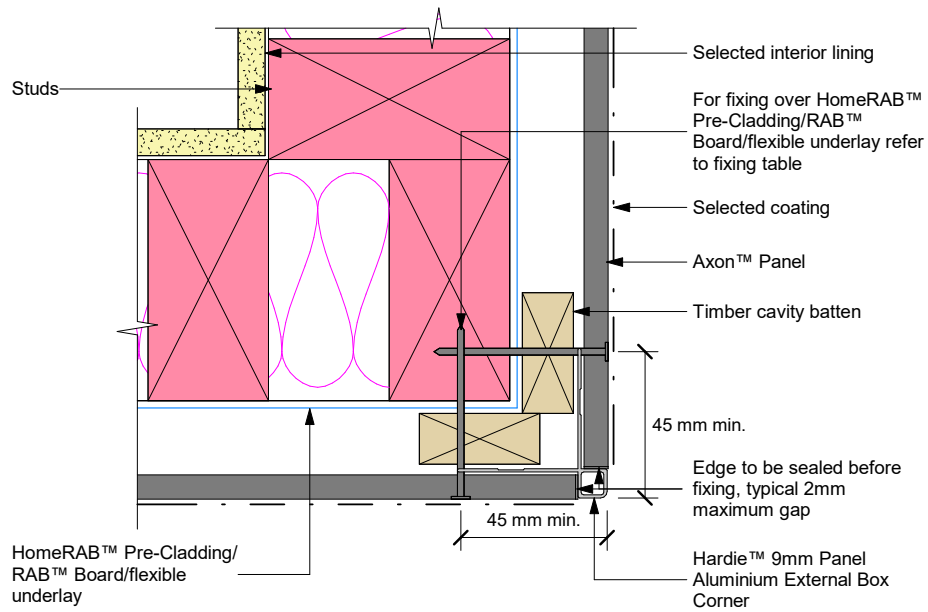

Note:
 • Refer to Figure 30 for jointing with 'h' mould

Figure 10: Hardie™ Axent™ Trim™ at internal corner

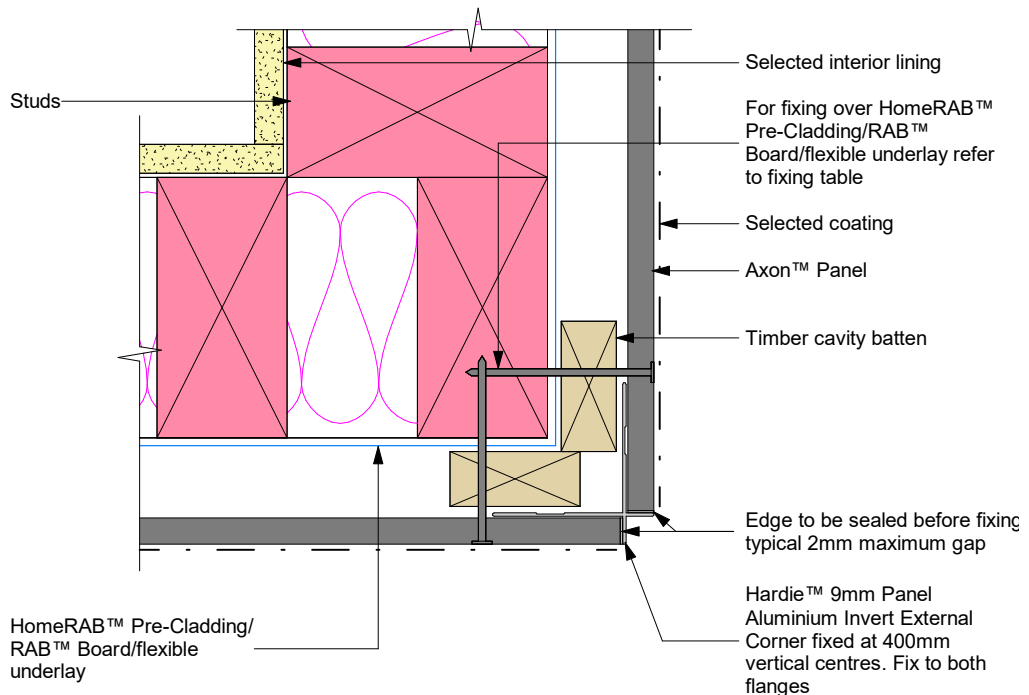


Figure 11: Axent™ Trim™ at external corner

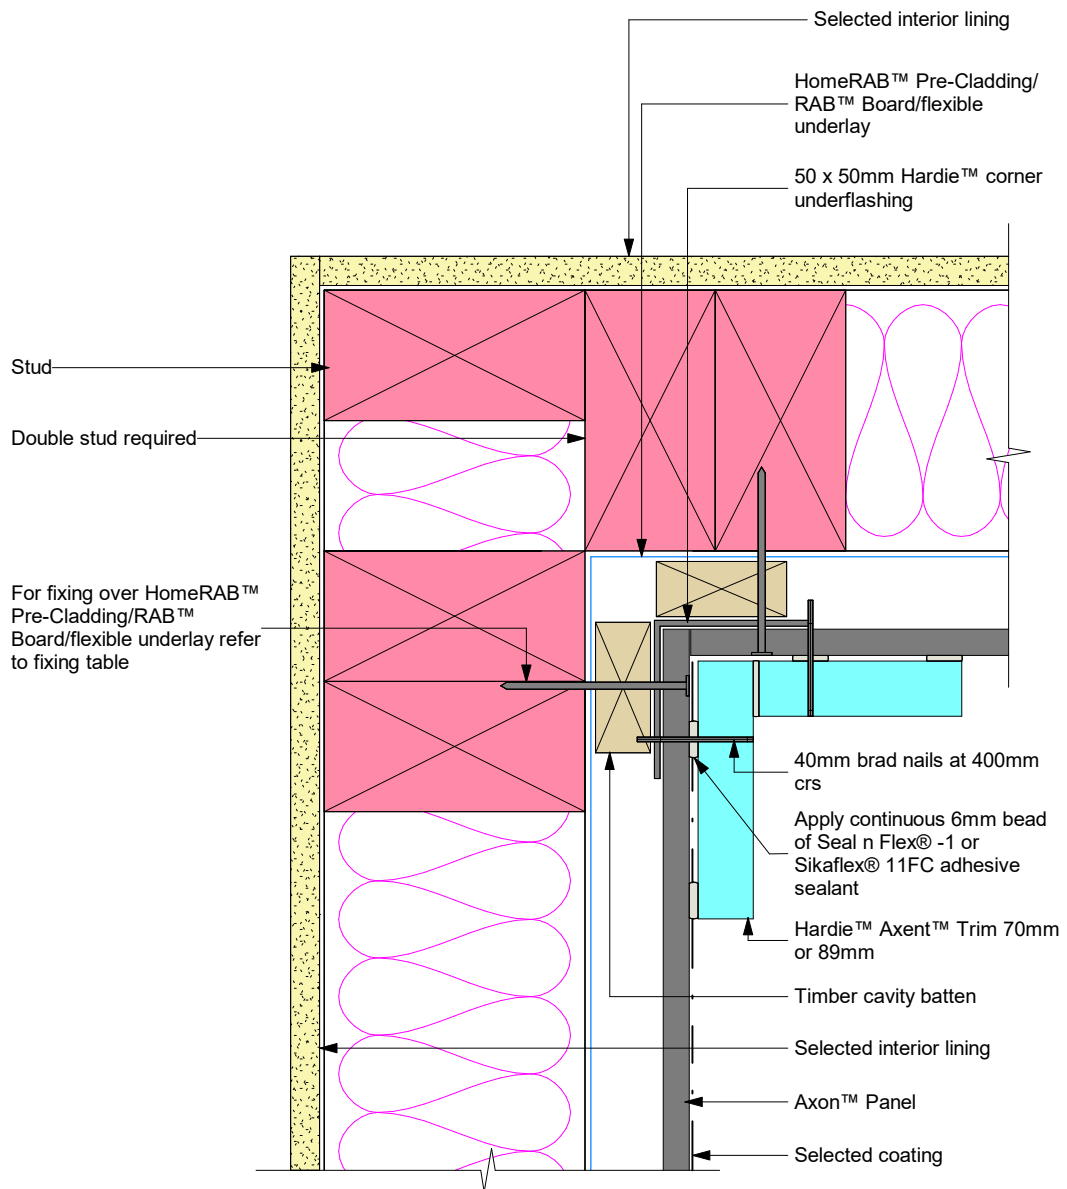


Figure 12: Hardie™ Axent™ Trim to Axon™ Panel at joint

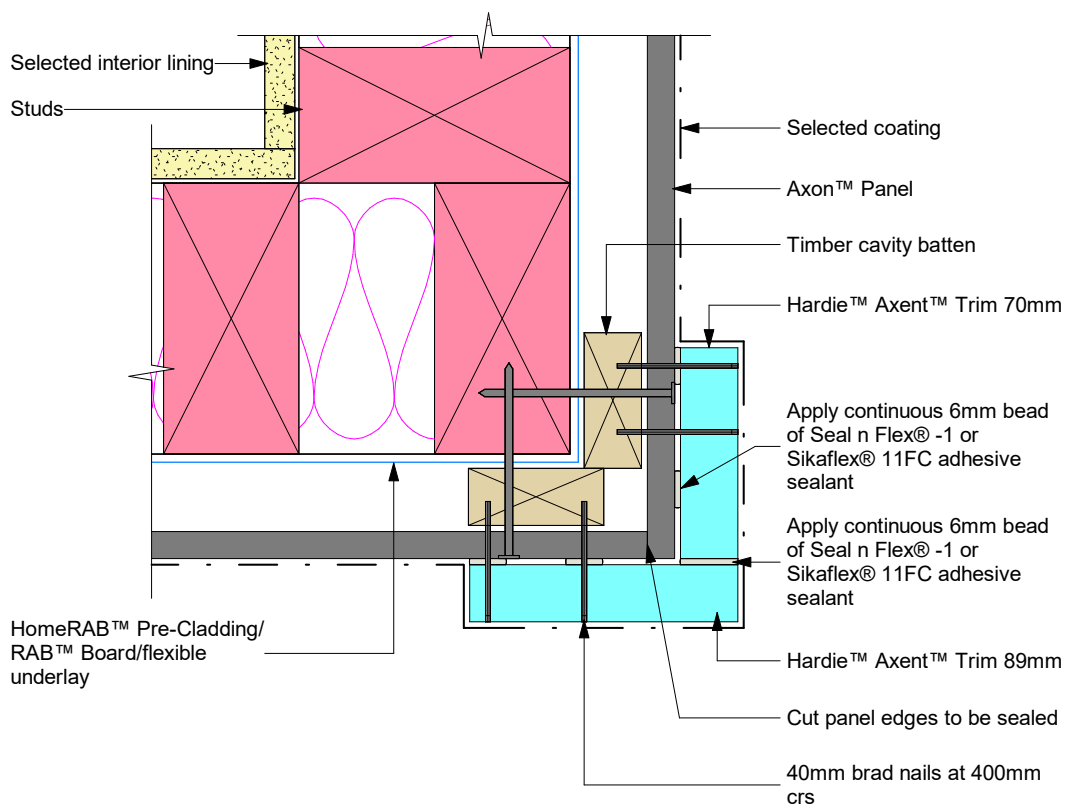


Figure 13: Hardie™ Axent™ Trim to Axon™ Panel at non joint


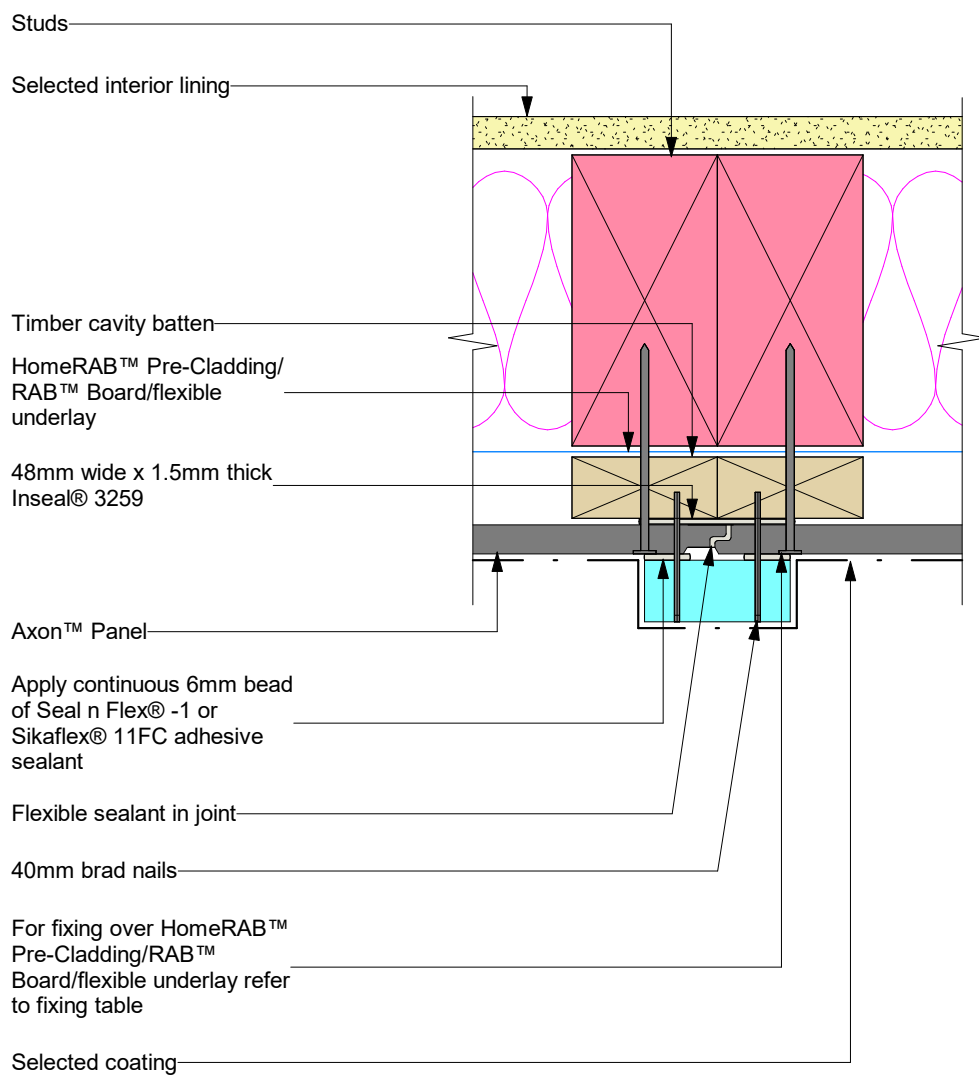


Figure 14: Hardie™ Axent™ Trim to Axon™ Panel at non joint

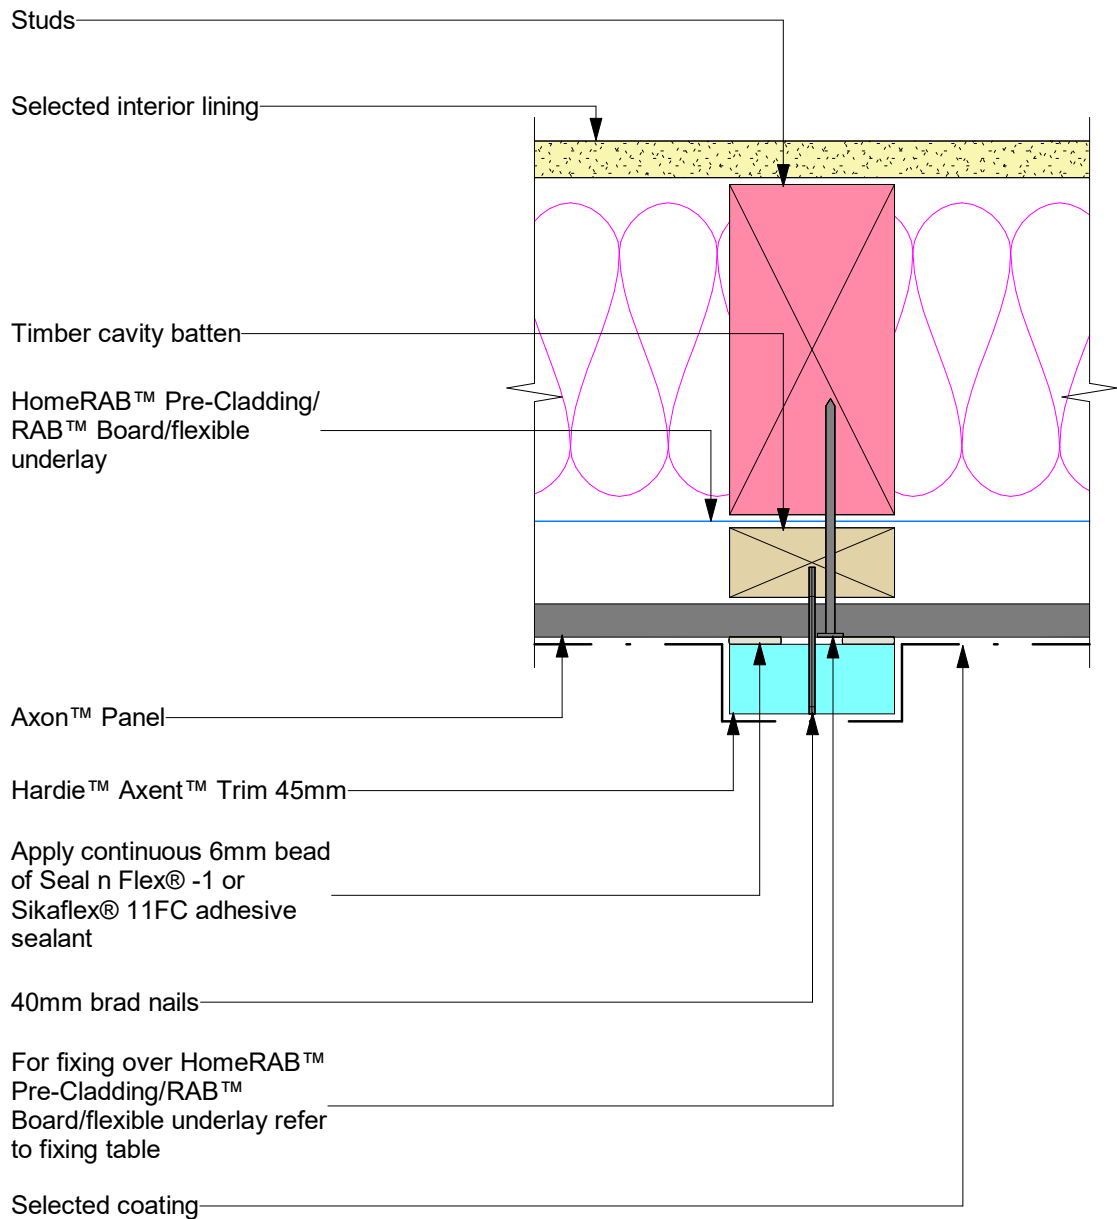

Note:

- * Ensure that the required edge distance is maintained when fixing.
- * Seal cut edges with a primer compatible with final coatings.

Figure 15: Hardie™ Axent™ Trim fixing



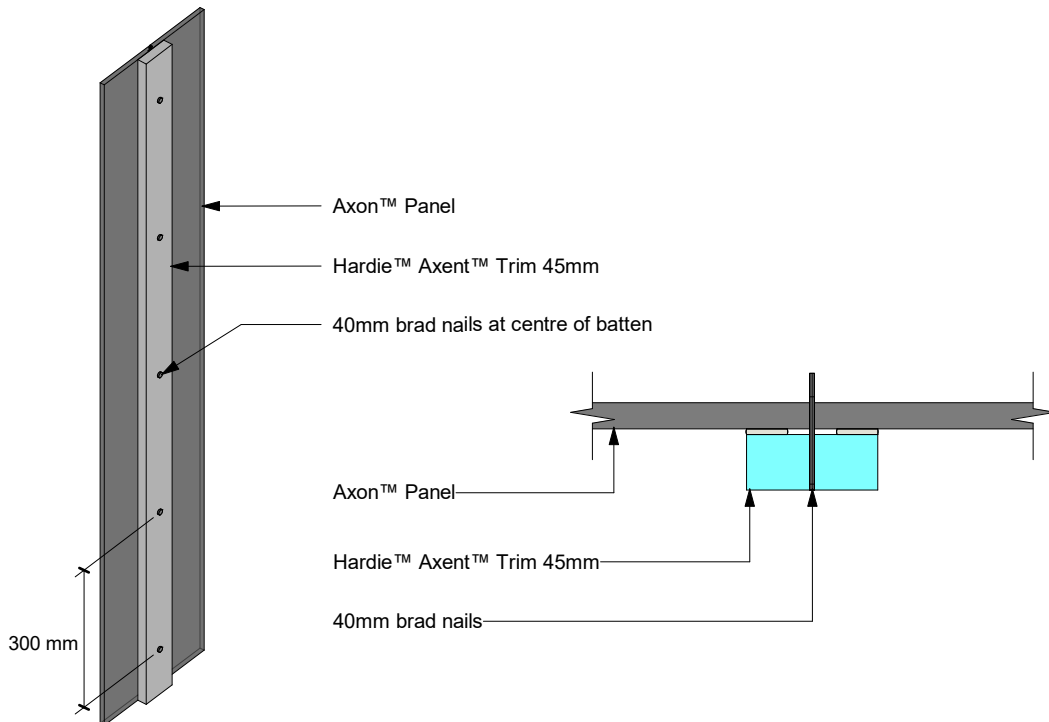


Figure 16: Vertical sealant joint

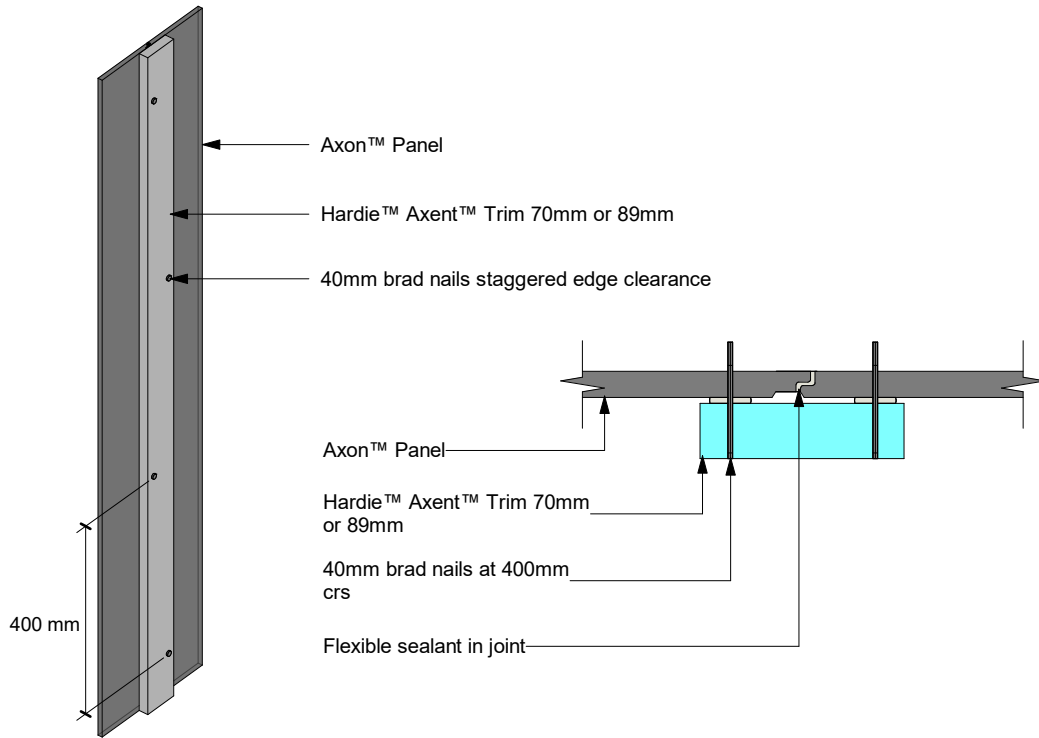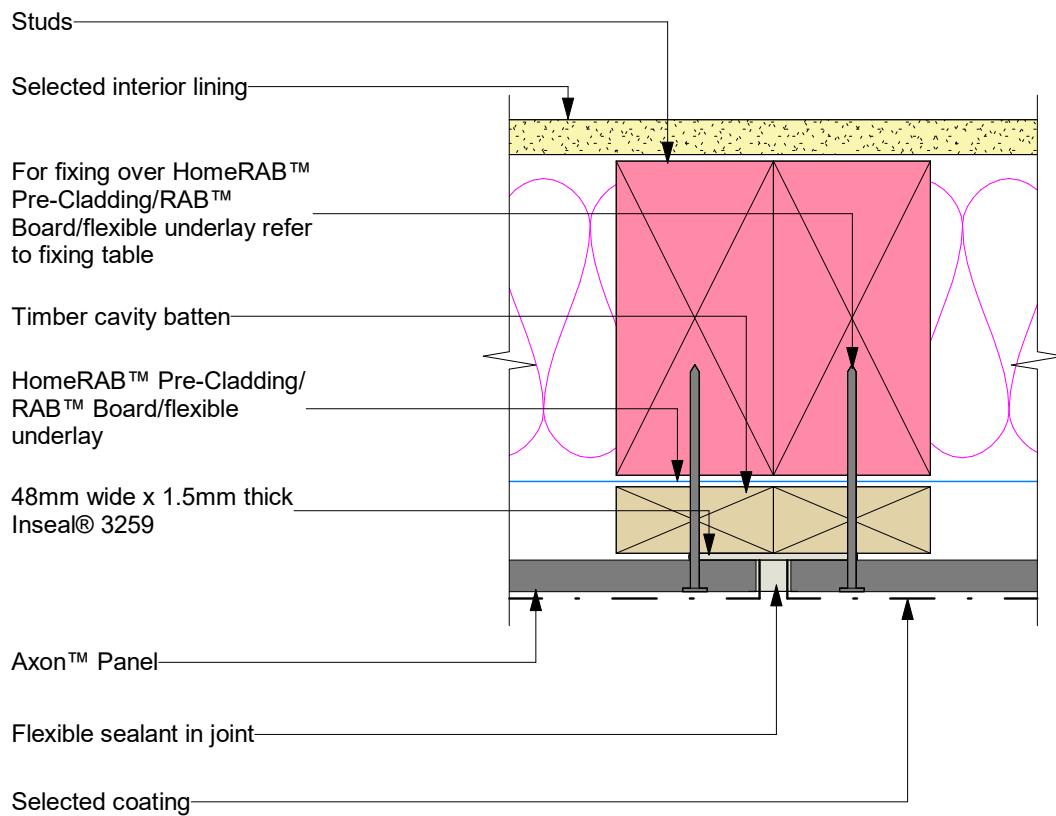


Note:

- * Ensure that the required edge distance is maintained when fixing.
- * Seal cut edges with a primer compatible with final coatings.

For use ONLY where manufactured edge jointing not possible for build ie small window in full sheet

Figure 17: Soffit detail

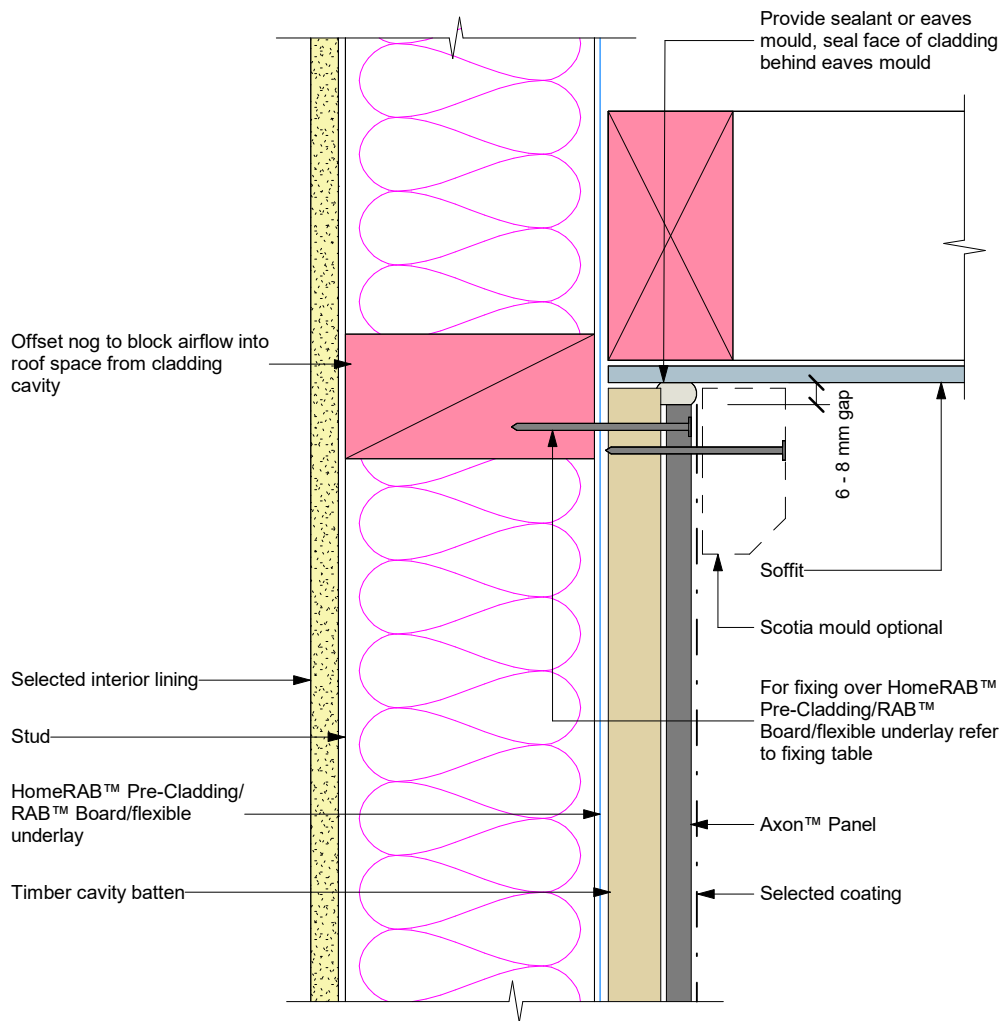

Note: Site cut edges to be primed.
 Ensure cavity does not vent into roof space. Refer to E2/AS1 clause 9.1.8.2

Figure 18: Nil soffit detail


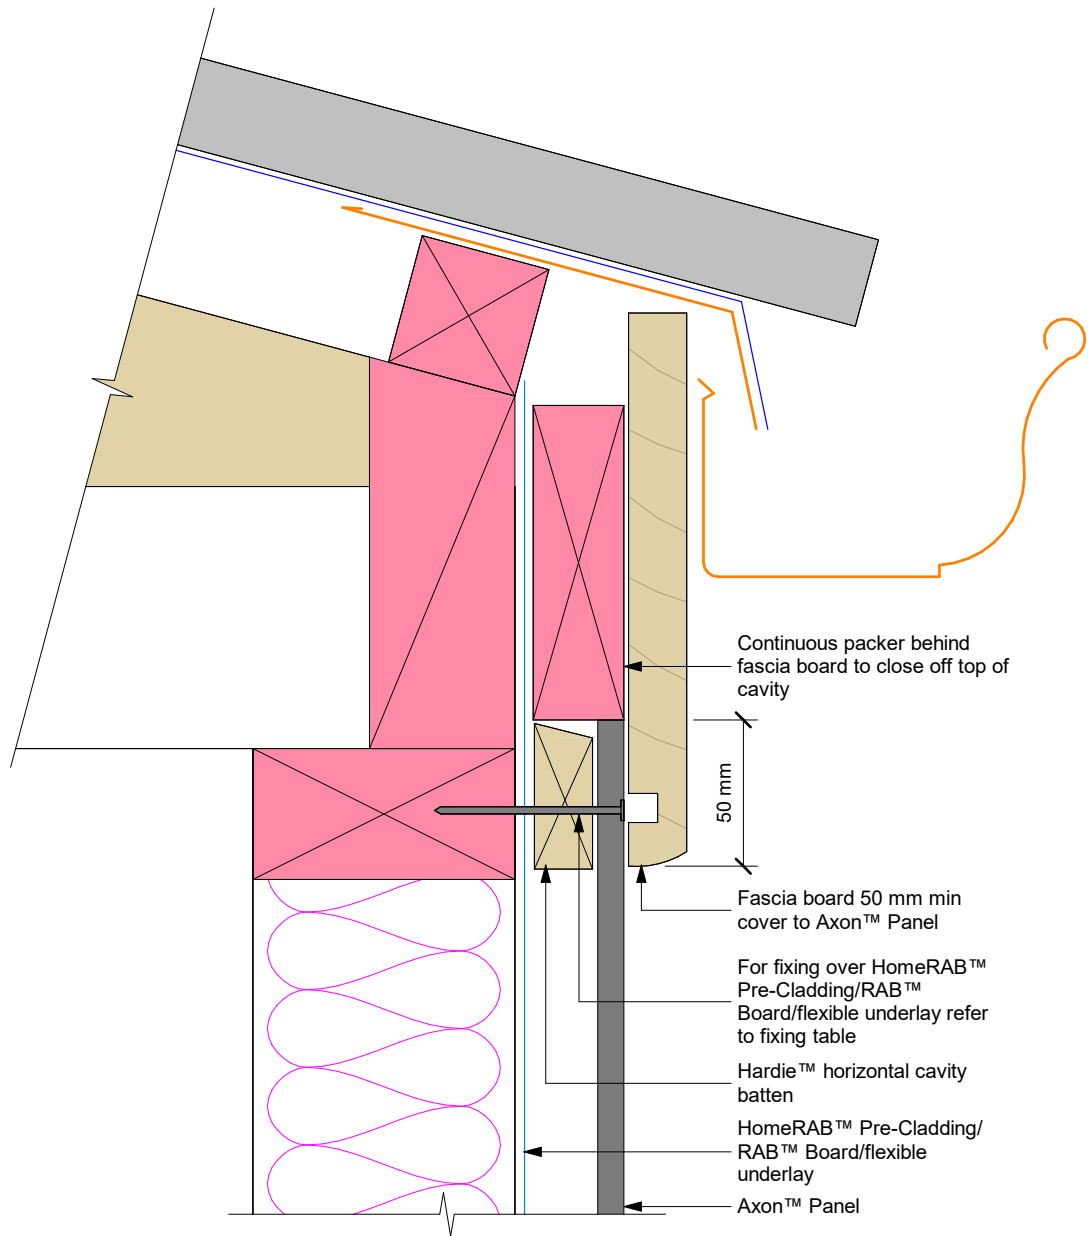



Figure 19: Window head

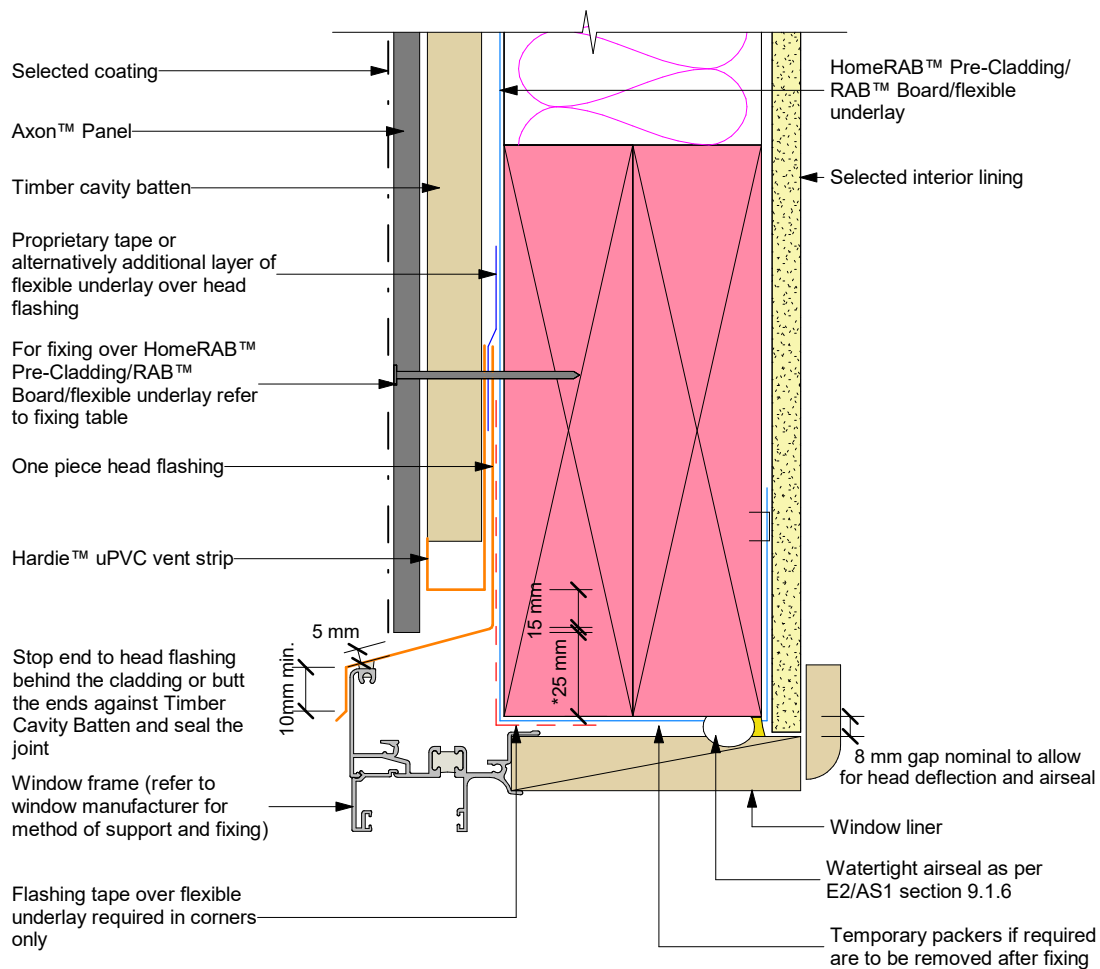

Note:

- * When HomeRAB™ Pre-Cladding/RAB™ Board is used flashing tape to be applied to the entire window opening.
- * Also refer to Figure 116 NZBC clause E2/AS1 for head and jamb details
- * Sealant must be applied between head flashing and window flange VH and EH wind zones and SED wind pressures
- * Alternatively, the head flashing can be formed with stop ends as per E2/AS1

Figure 20: Window sill

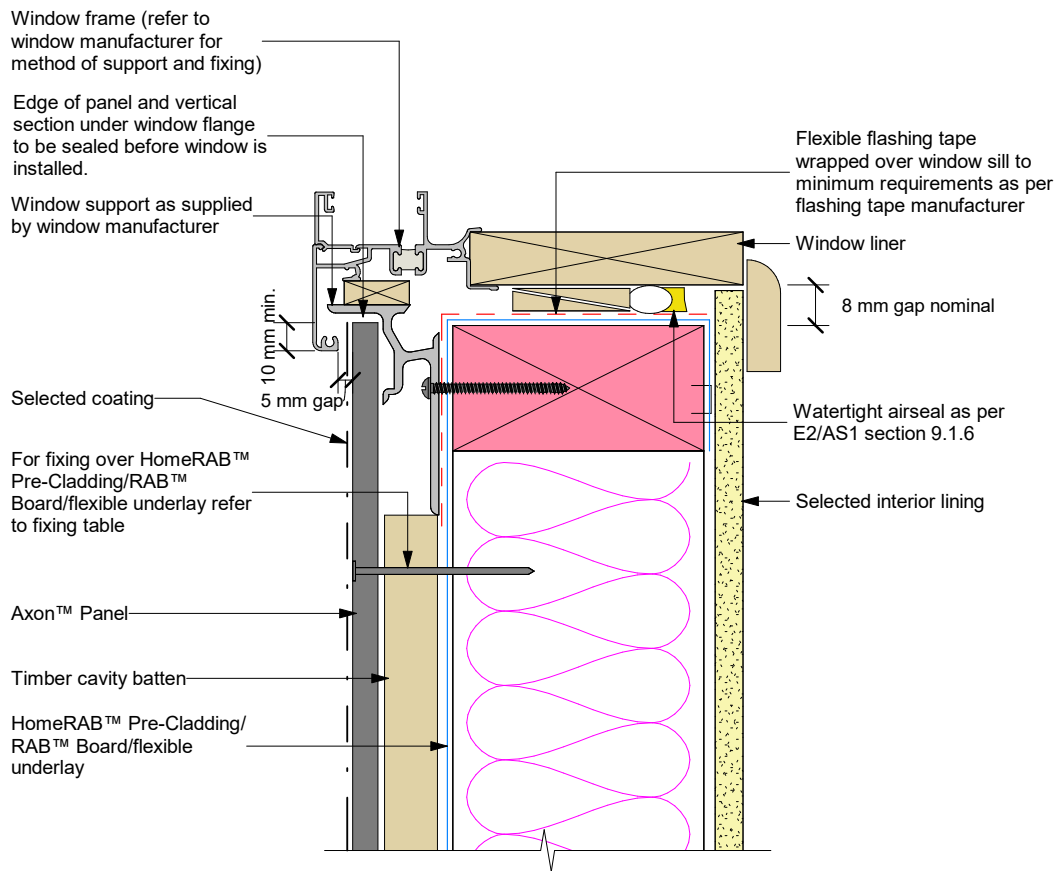


General notes for materials selection

- * Flexible underlay must comply with acceptable solution E2/AS1.
- * Flashing tape must have proven compatibility with the selected flexible underlay and other materials with which it comes into contact.
- * When HomeRAB™ Pre-Cladding/ RAB™ Board are used flashing tape to be applied to the entire opening.


Refer to the manufacturer or supplier for technical information for these materials.

Figure 21: Window jamb

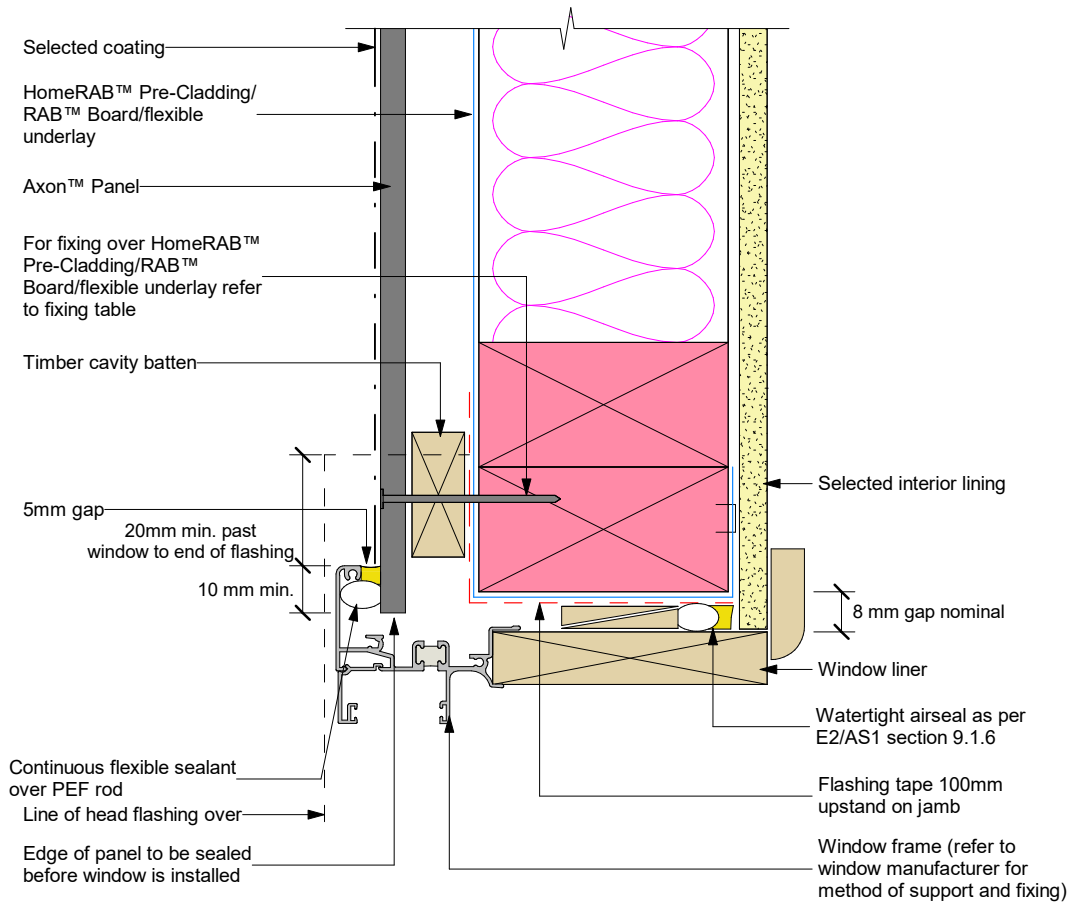

Note: When HomeRAB™ Pre-Cladding/RAB™ Board is used flashing tape to be applied to the entire window opening.

Figure 22: Window jamb with scriber

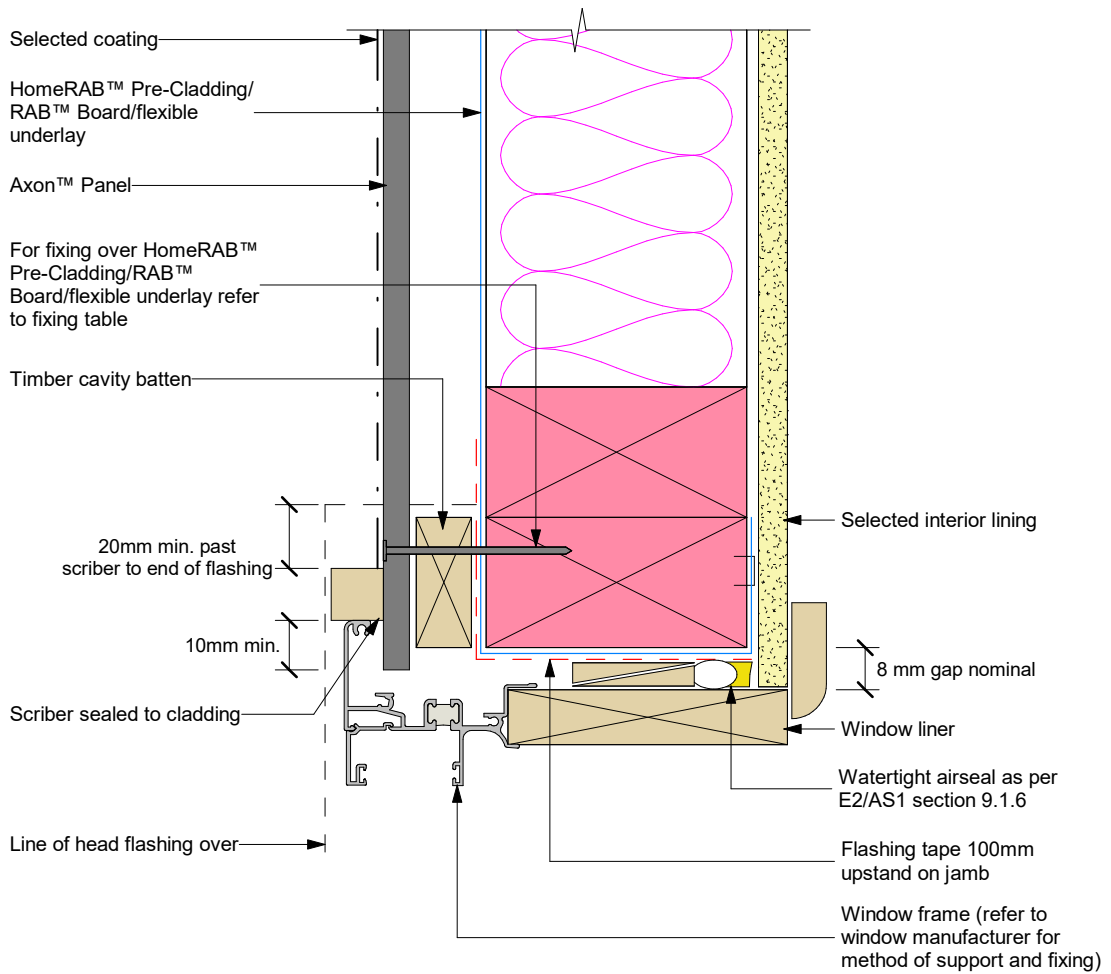

Note: When HomeRAB™ Pre-Cladding/RAB™ Board is used flashing tape to be applied to the entire window opening.

Figure 23: Cavity alternative head flashing termination against batten


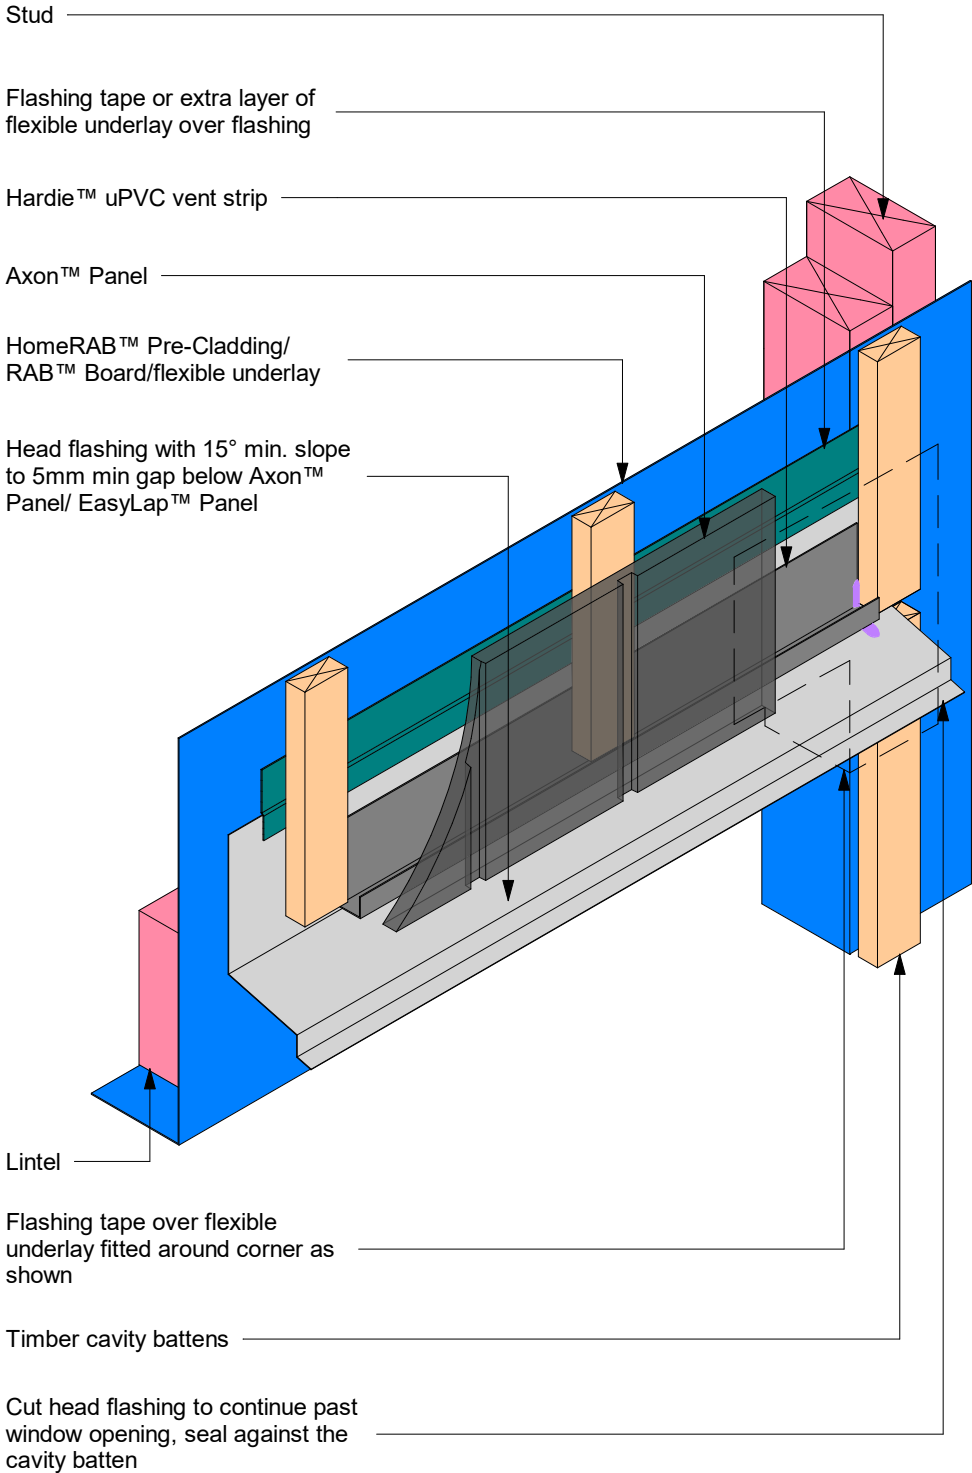



Figure 24: Window head with facing

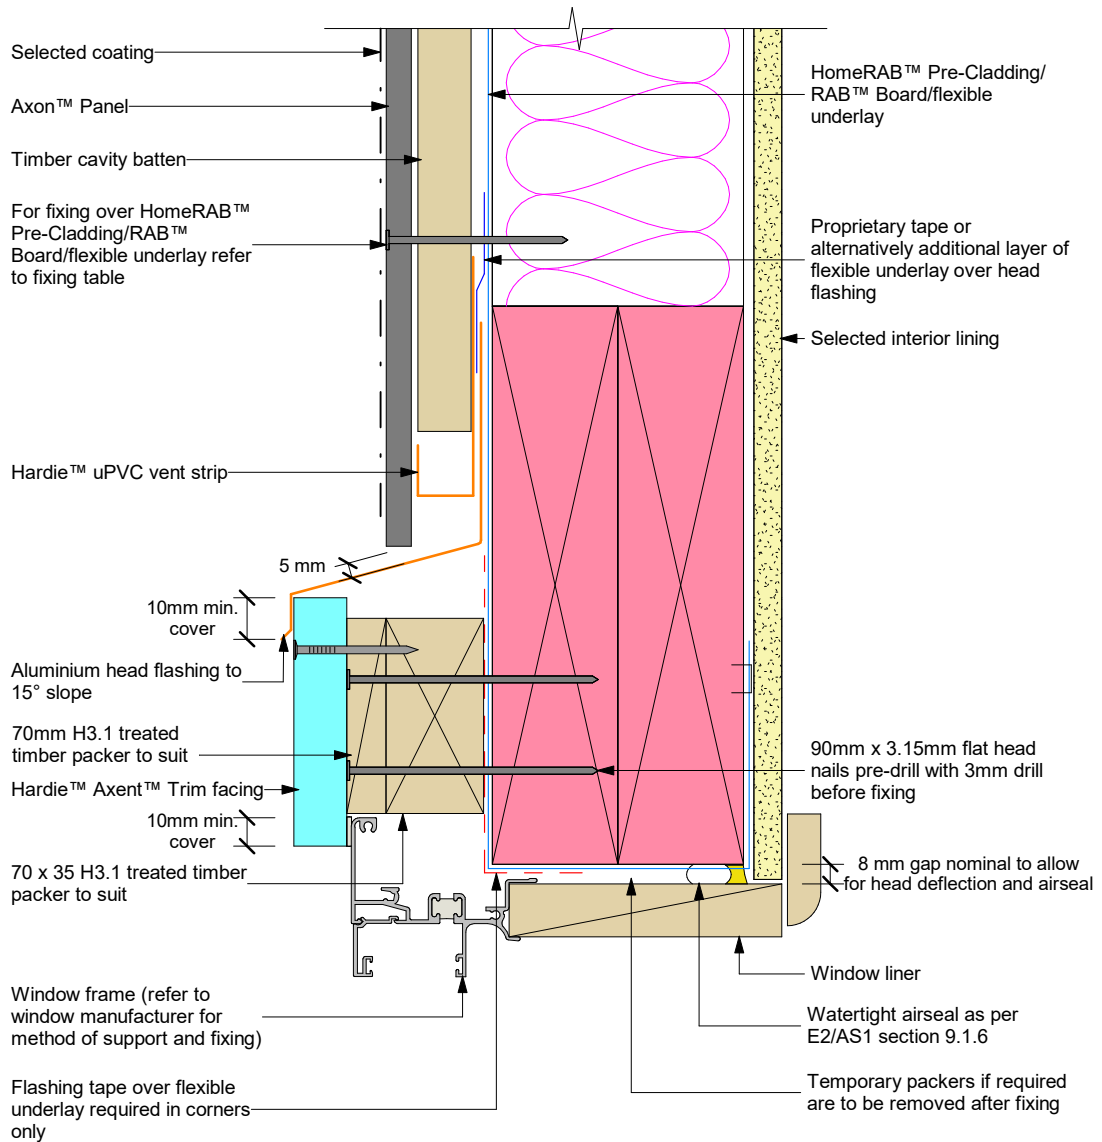

Note:

- When HomeRAB™ Pre-Cladding/ RAB™ Board is used flashing tape to be applied to the entire window opening
- Sealant must be installed between Hardie™ Axent™ Trim and window flange in VH and EH wind zones and SED projects
- Alternatively, the head flashing can be formed with stop ends as per E2/AS1

Figure 25: Window sill with planted sill

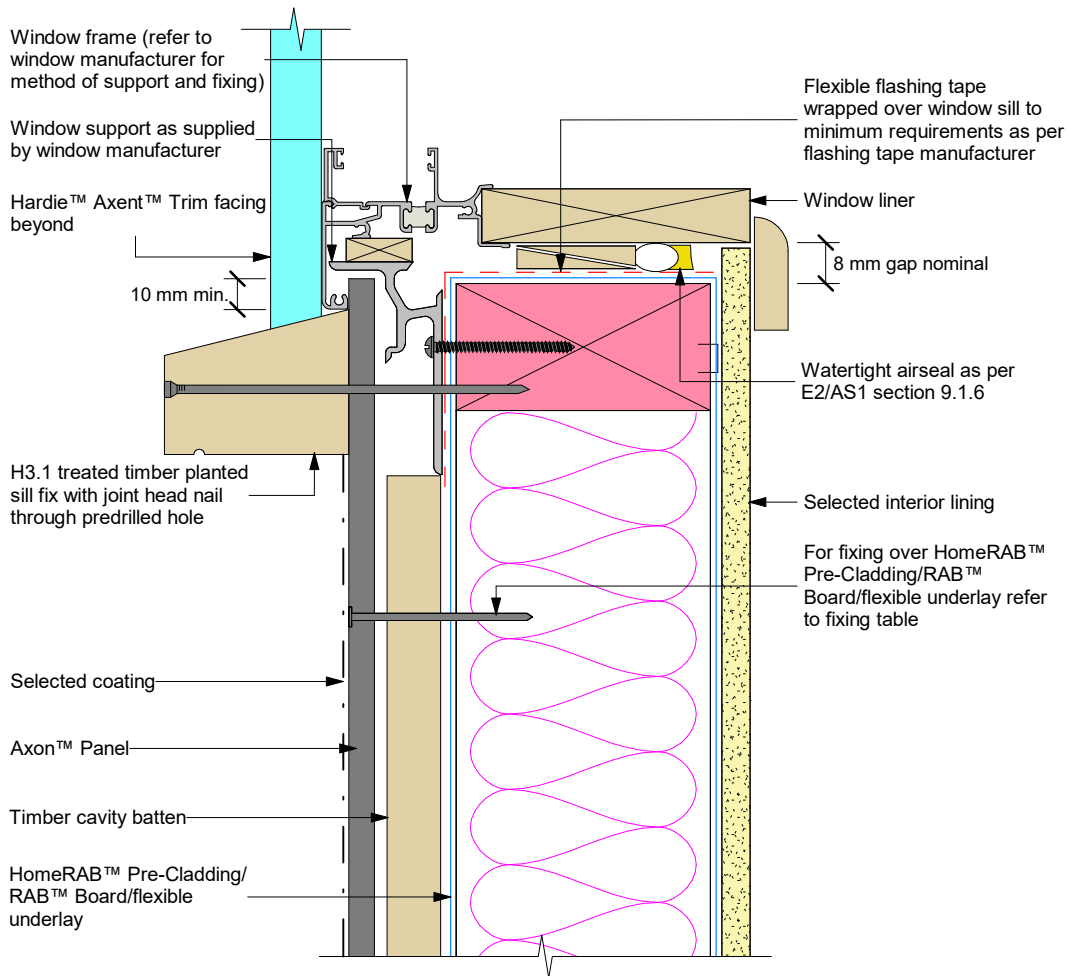


General notes for materials selection

- * Flexible underlay must comply with acceptable solution E2/AS1.
- * Flashing tape must have proven compatibility with the selected flexible underlay and other materials with which it comes into contact.
- * When HomeRAB™ Pre-Cladding/RAB™ Board are used flashing tape to be applied to the entire opening.


Refer to the manufacturer or supplier for technical information for these materials.

Figure 26: Window and door jamb with facing

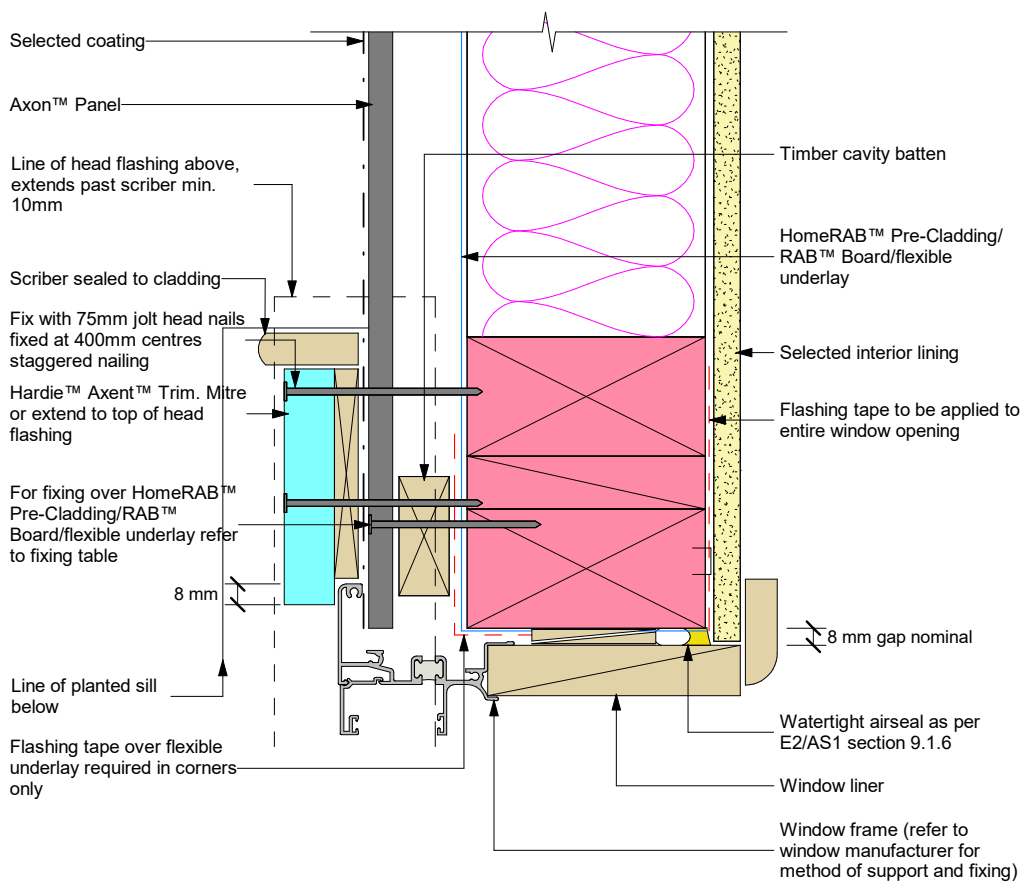


Note: When HomeRAB™ Pre-Cladding/RAB™ Board is used flashing tape to be applied to the entire window opening.

Figure 27: Cavity horizontal joint detail

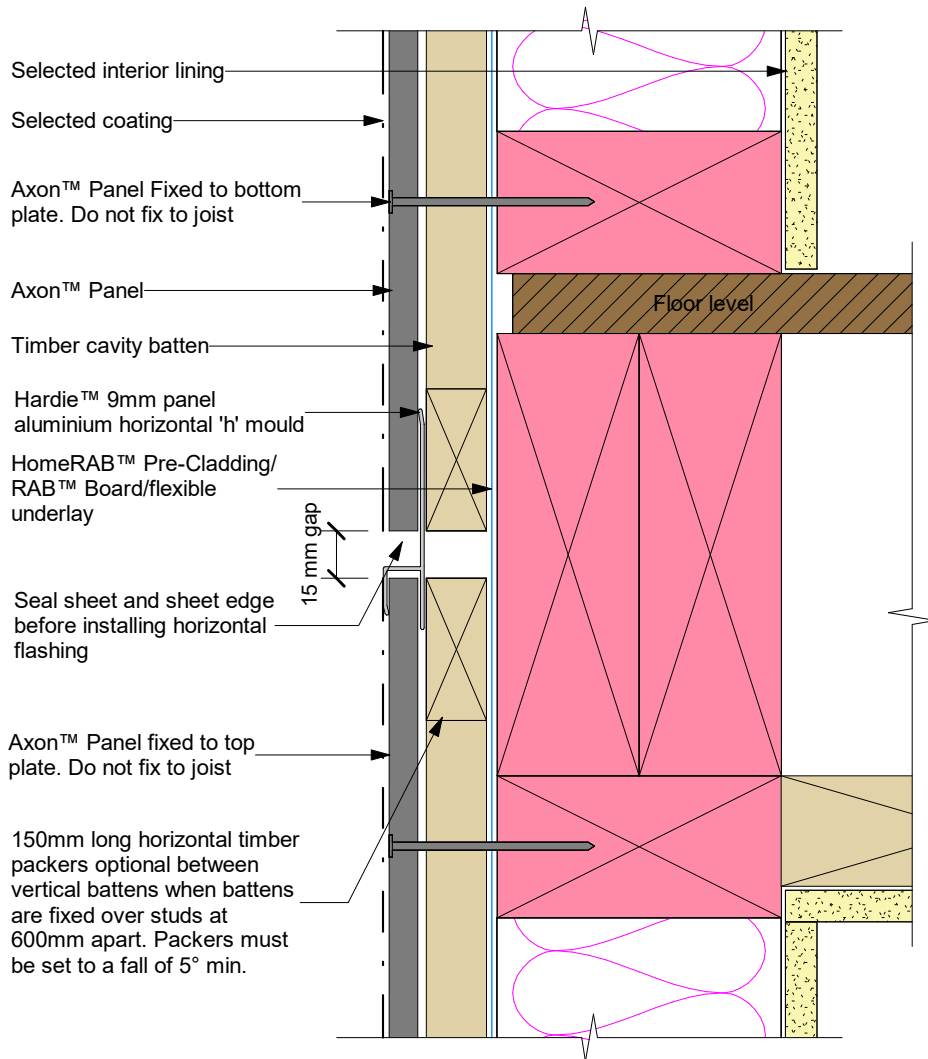

Note: When 50 year durability is required refer Table 20 of NZBC E2/AS1 document.

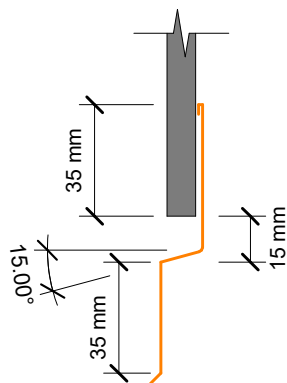

Alternative Flashing Option

Figure 28: Horizontal joint in tall wall

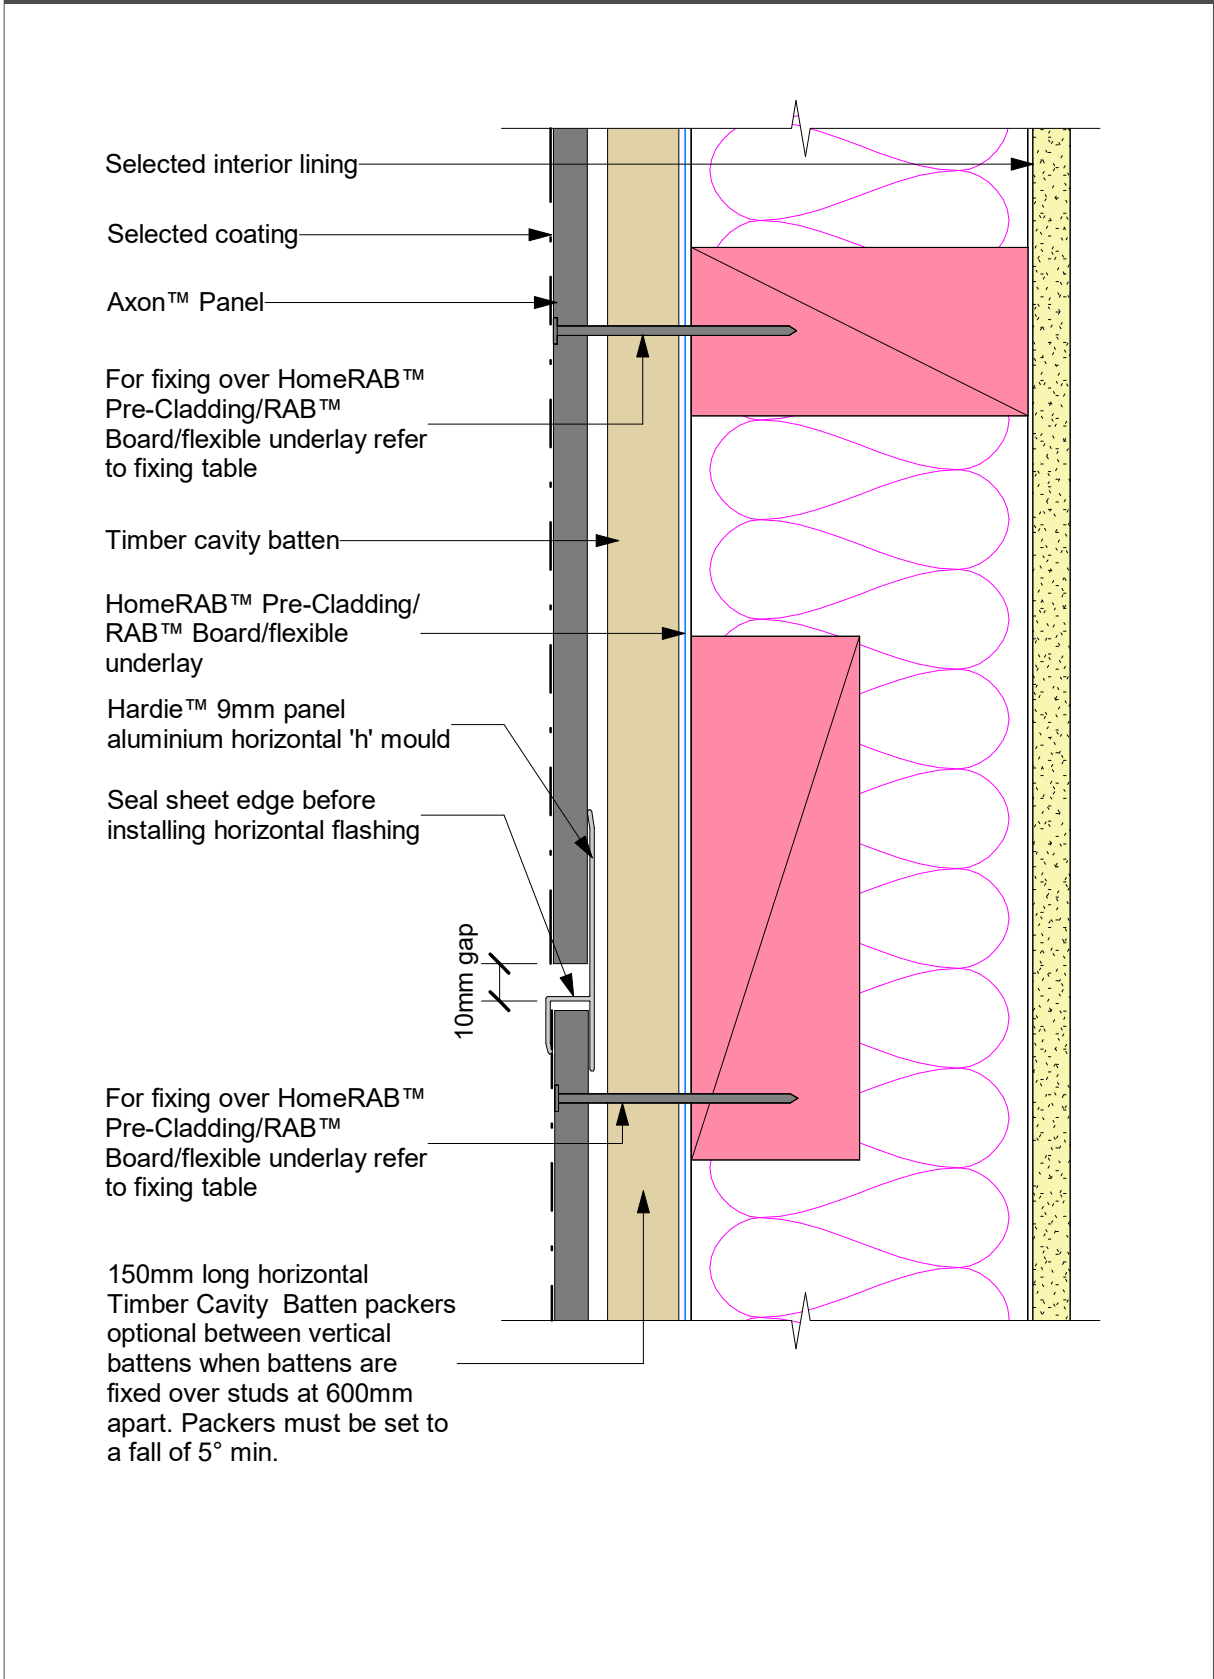


Figure 29: Cavity aluminium 'H' mould joiner


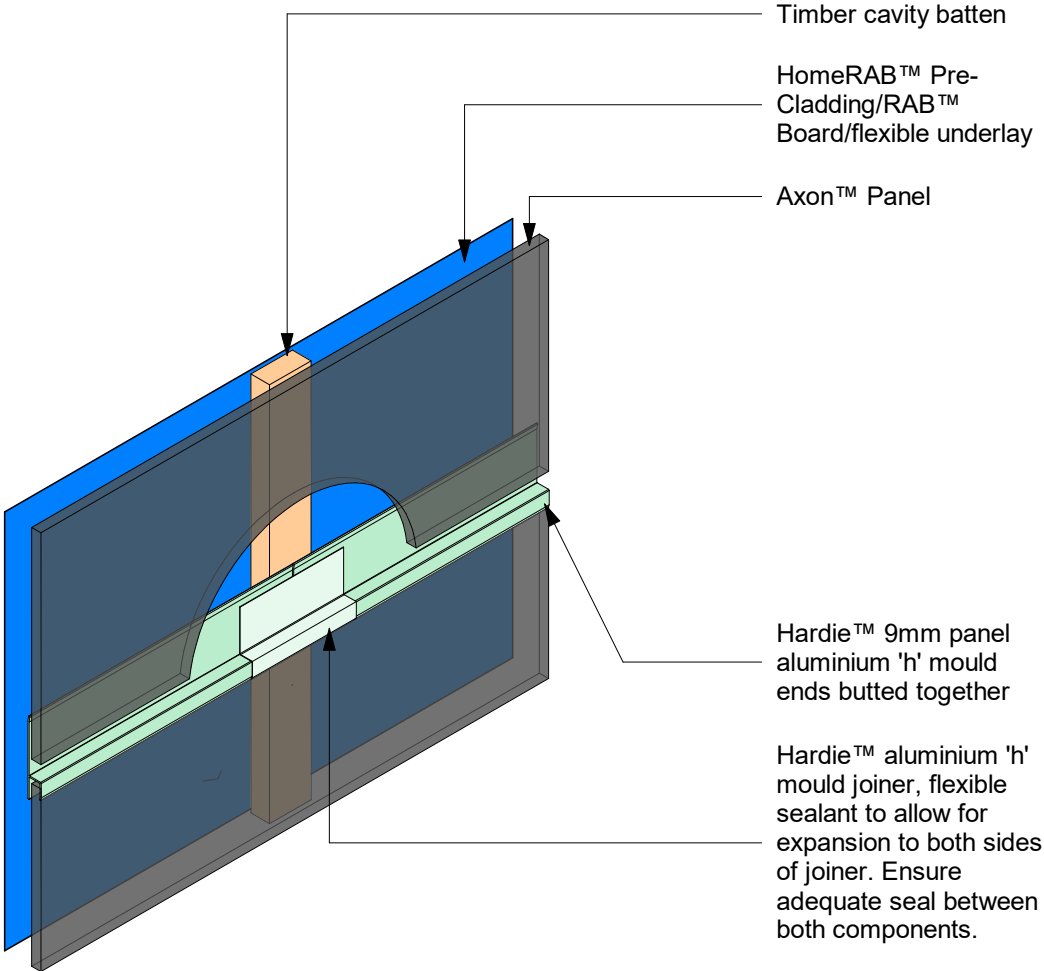


Figure 30: Cavity corner at 'H' mould joint detail

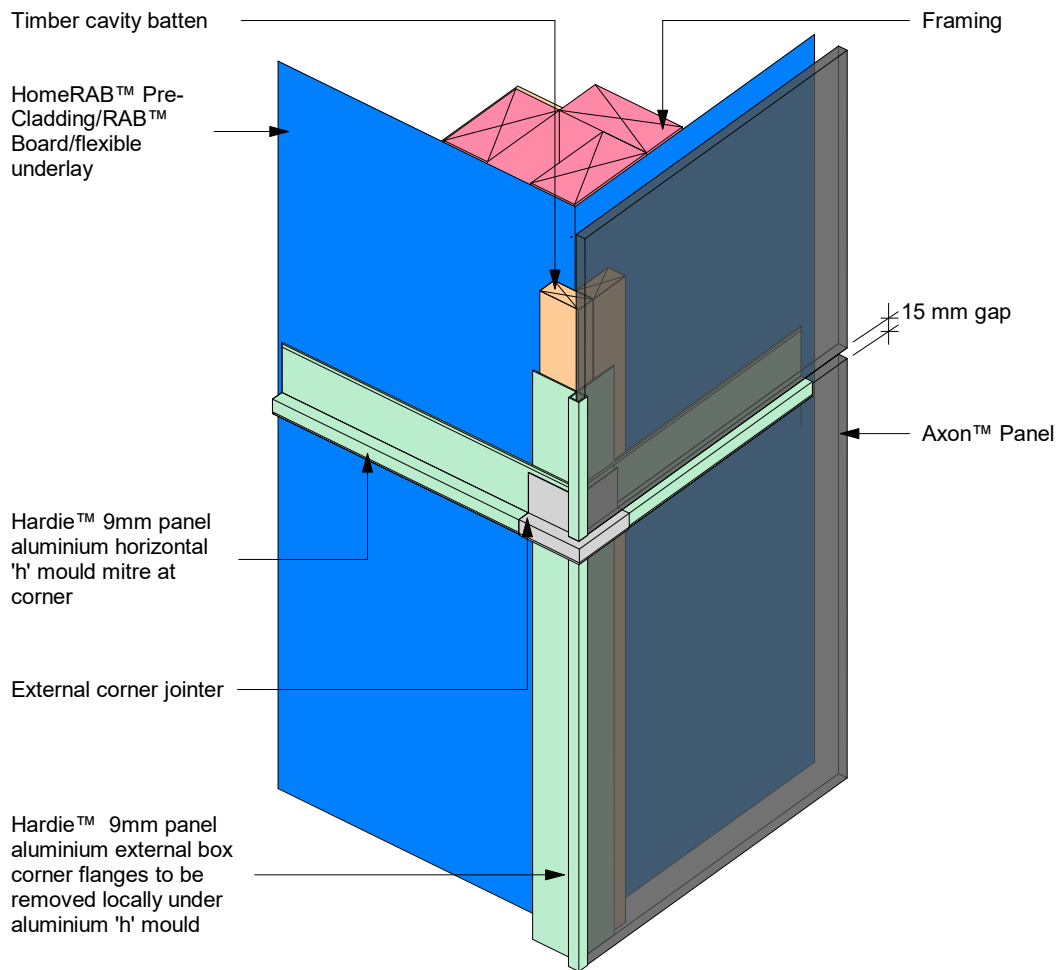

Note: Site cut edges to be primed

Figure 31: Internal corner at 'H' mould joint detail


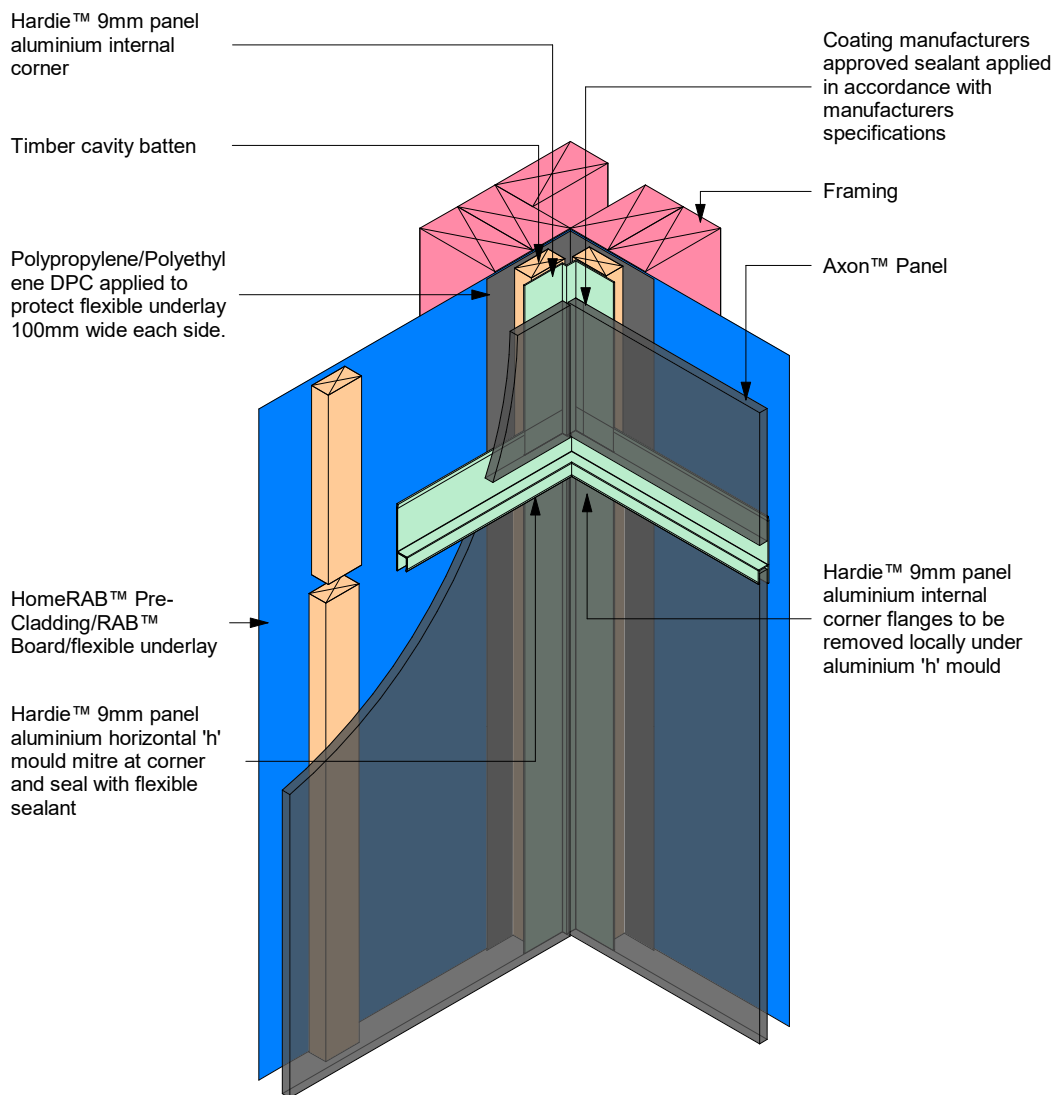



Figure 32: Angle 'T' socket joint at floor joist

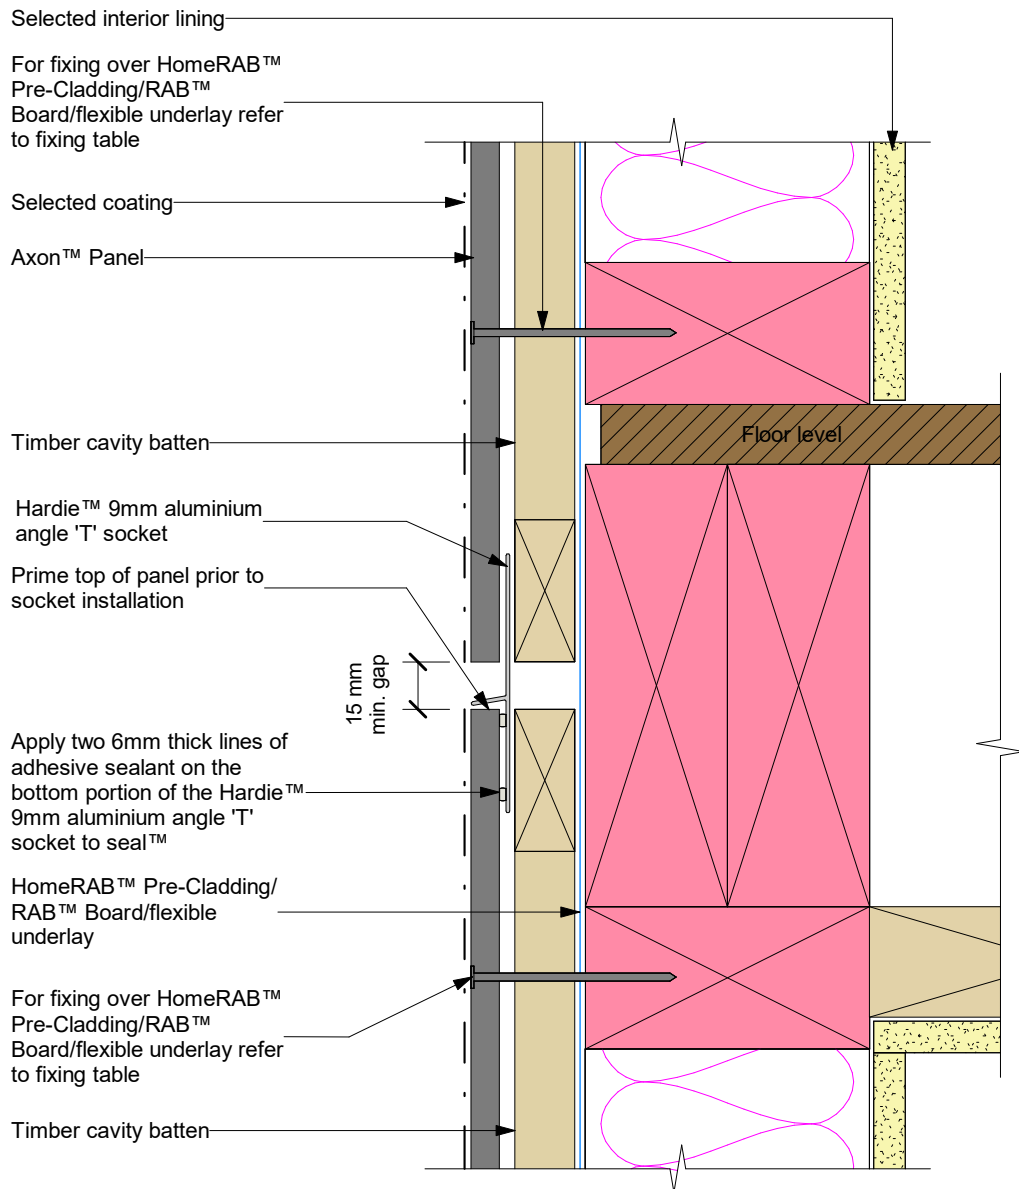

Notes:

- When 50 year durability is required refer Table 20 of NZBC E2/AS1 document
- The flashing to be placed in the centre of the floor joists. Do not fix cavity battens or cladding into floor joists
- Hardie™ 9mm aluminium angle 'T' socket, take care to ensure continuous seal is formed between panel and the angle 'T' socket
- Hardie™ angle 'T' horizontal jointer will be required over the butt joint of the Hardie™ 9mm aluminium angle 'T' socket
- Site cut edges to be primed


Figure 33: Horizontal joint in tall wall

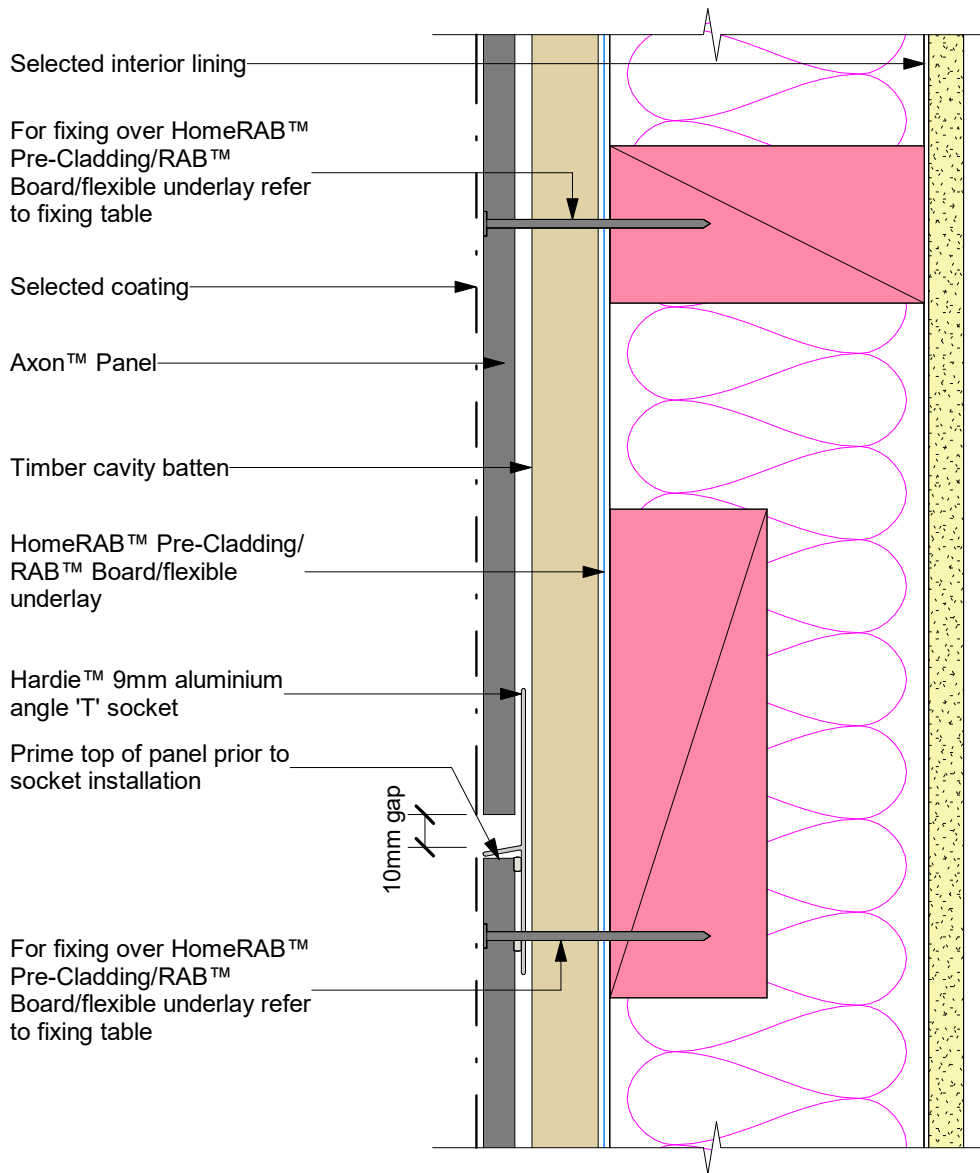

Notes:


- Hardie™ 9mm aluminium angle 't' socket, take care to ensure continuous seal is formed between panel and the angle 't' socket
- Hardie™ angle 'T' horizontal jointer will be required over the butt joint of the Hardie™ 9mm aluminium angle 't' socket
- Site cut edges to be primed

Figure 34: Angle 'T' horizontal jointer

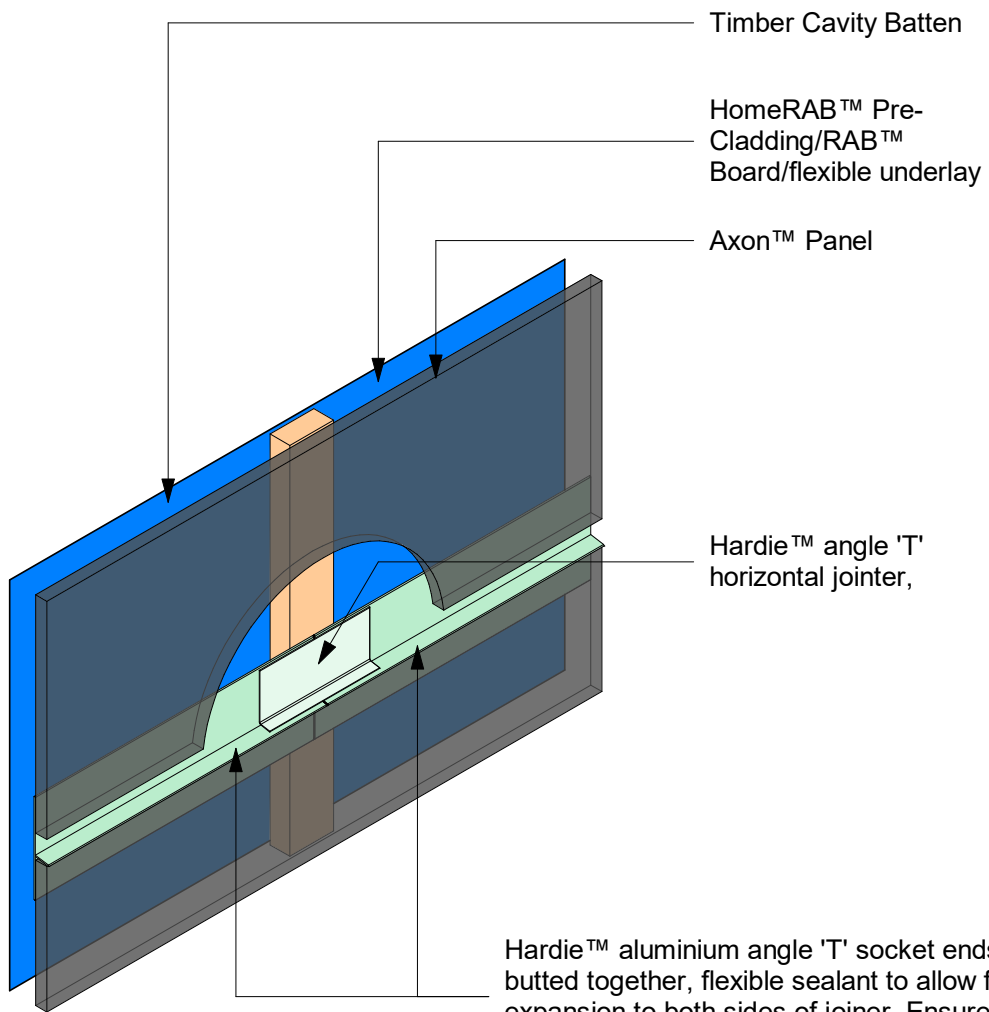

Hardie™ aluminium angle 'T' socket ends butted together, flexible sealant to allow for expansion to both sides of jointer. Ensure adequate seal between both components.

Figure 35: Angle 'T' external corner at 'T' mould joint

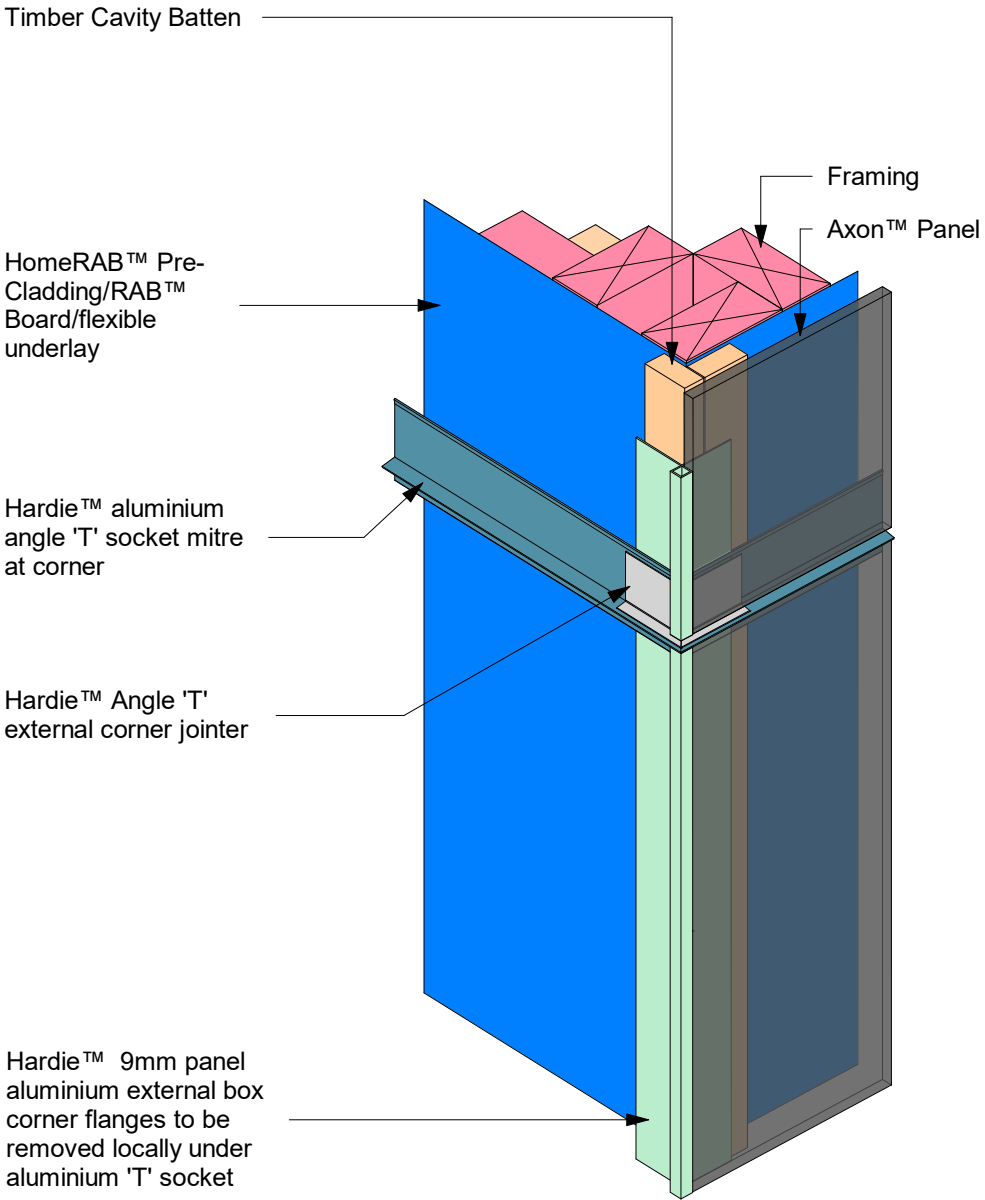

Note: Site cut edges to be primed

Figure 36: Internal corner at angle 'T' socket joint detail

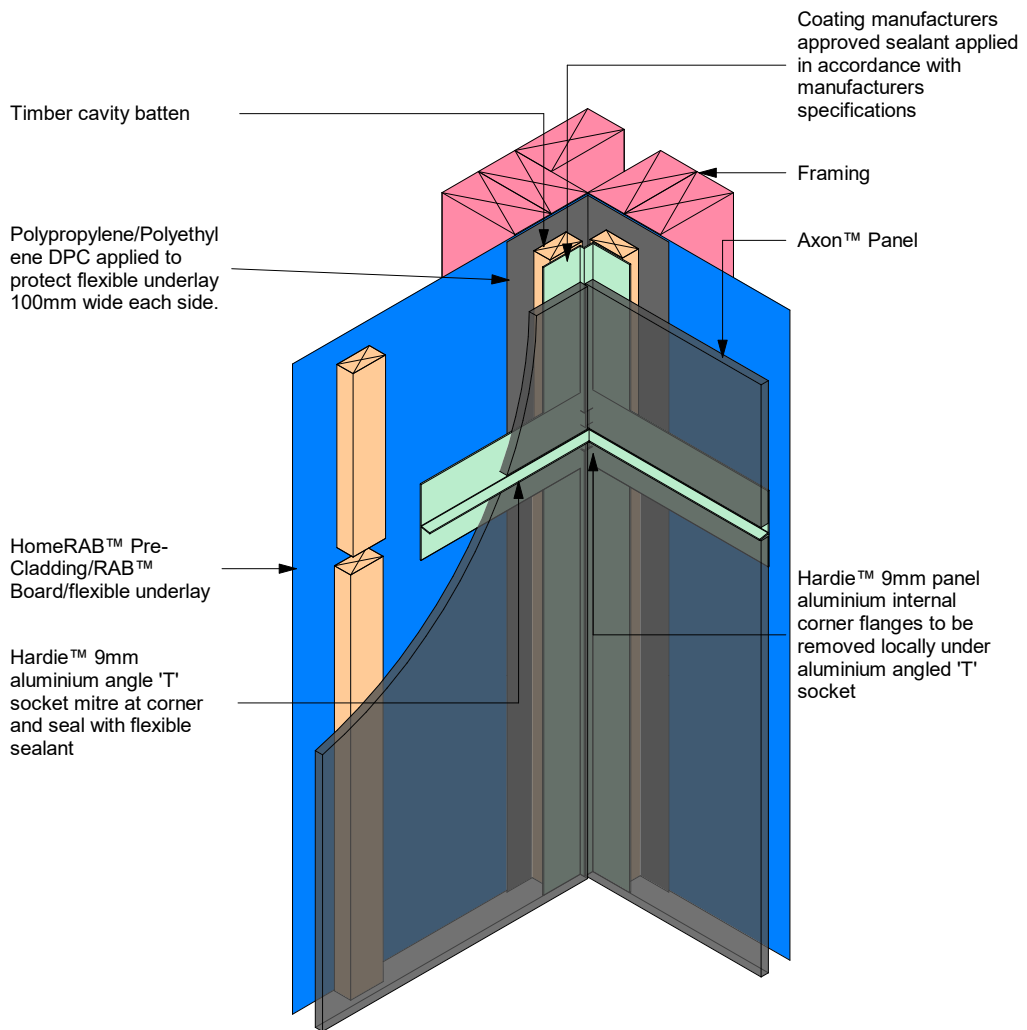


Figure 37: Joining moulding



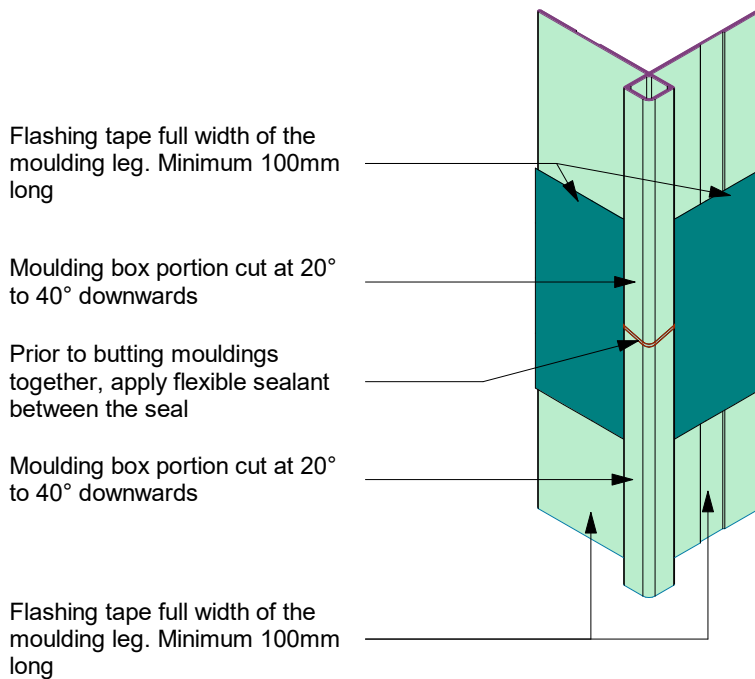


Figure 38: Cavity pipe penetration

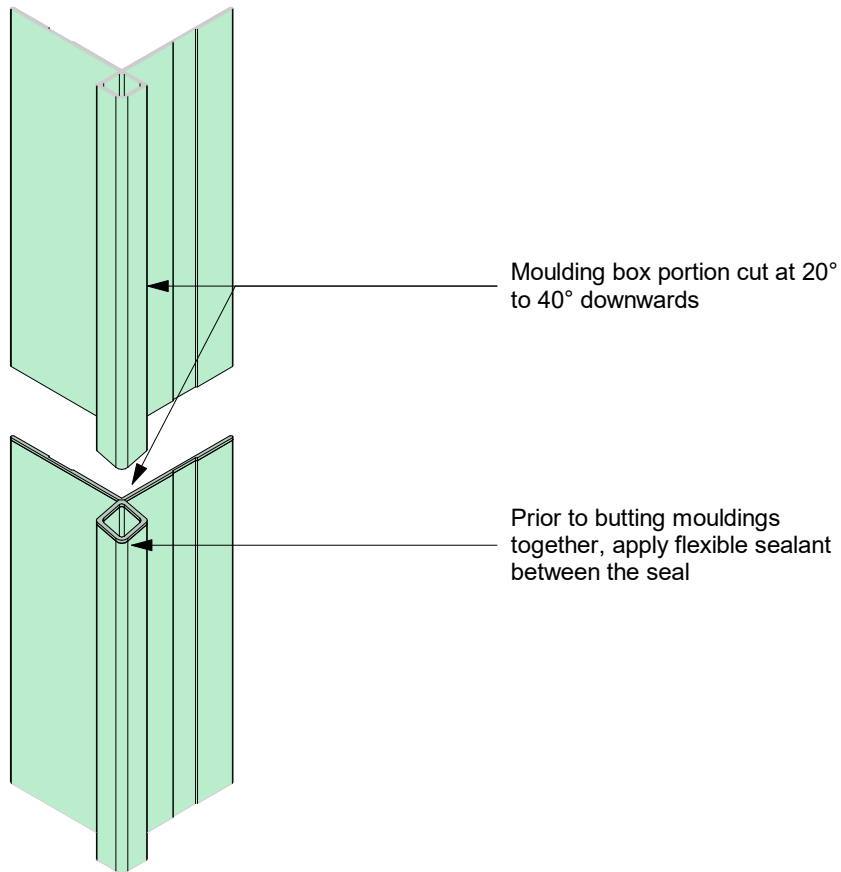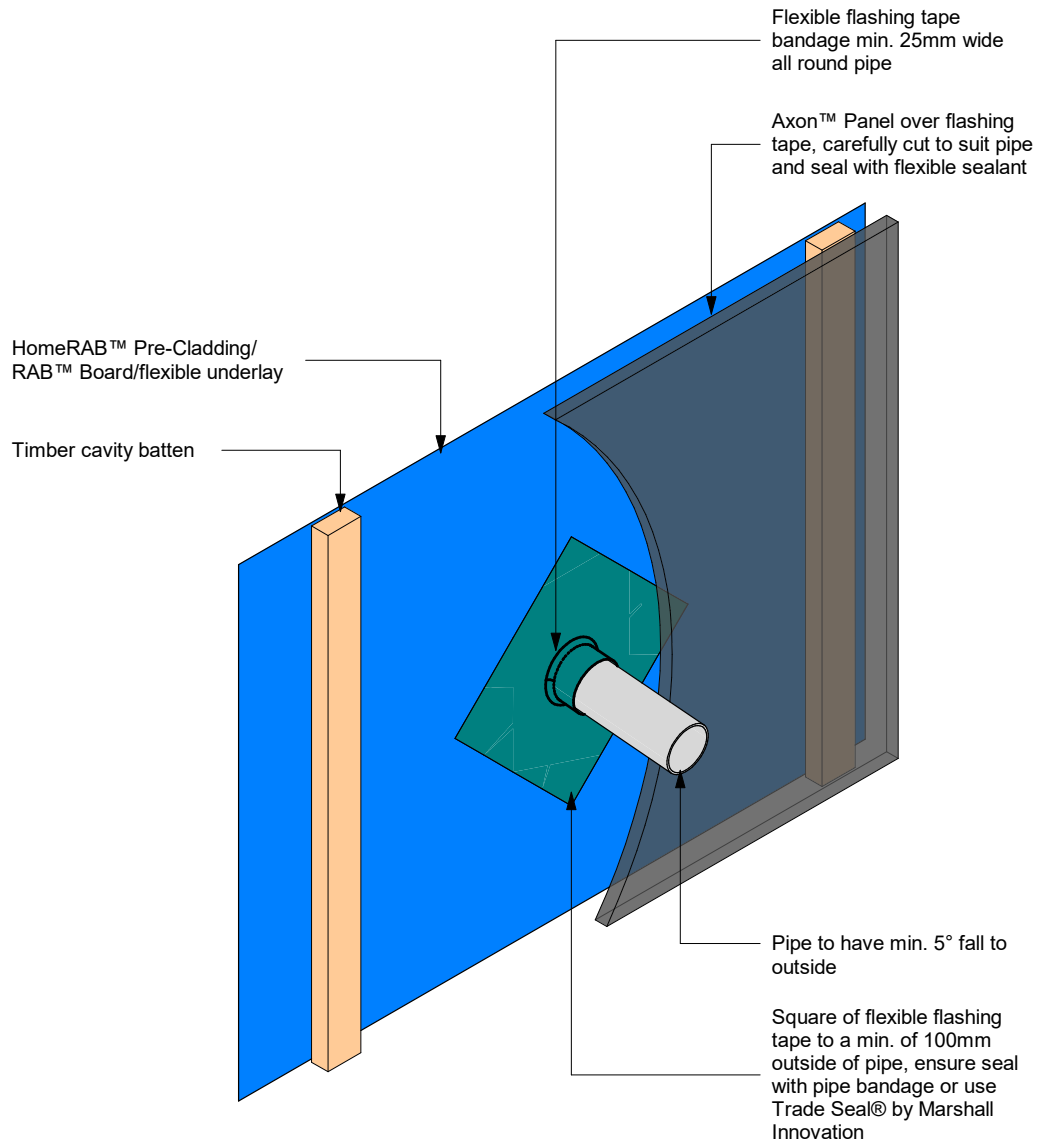

Note: Site cut edges to be primed

Figure 39: h' mould joint at window head

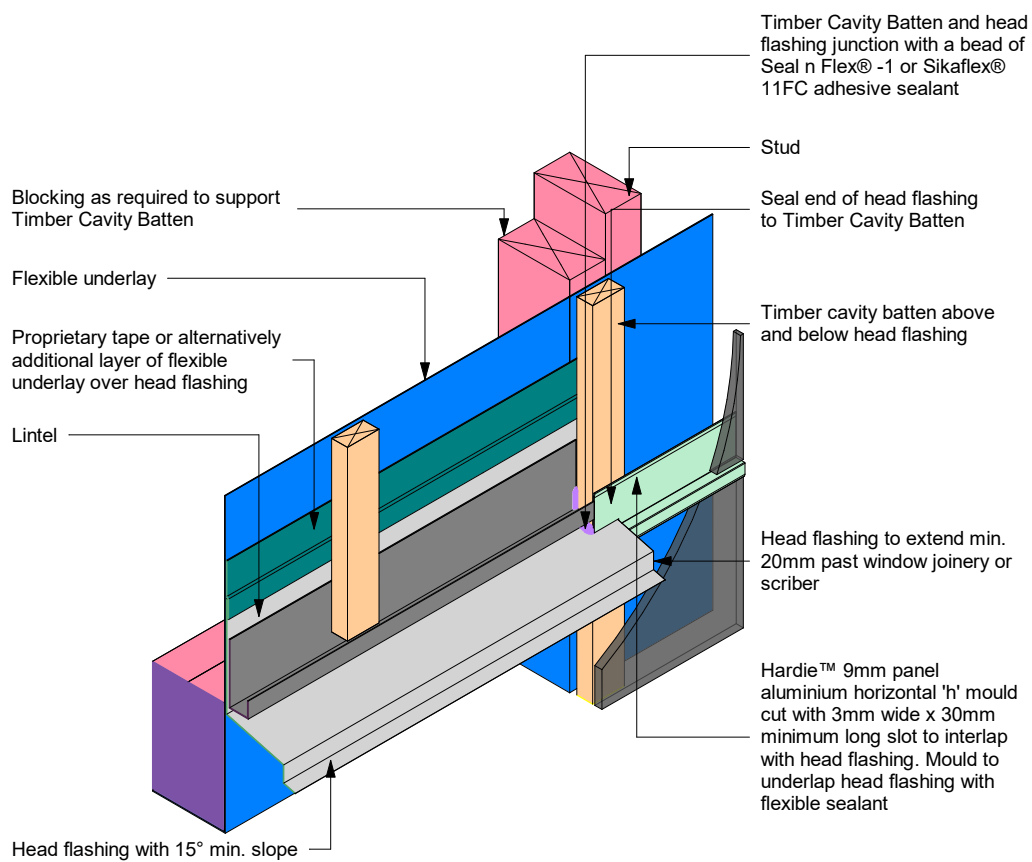


Figure 40: Angle 'T' socket at window head

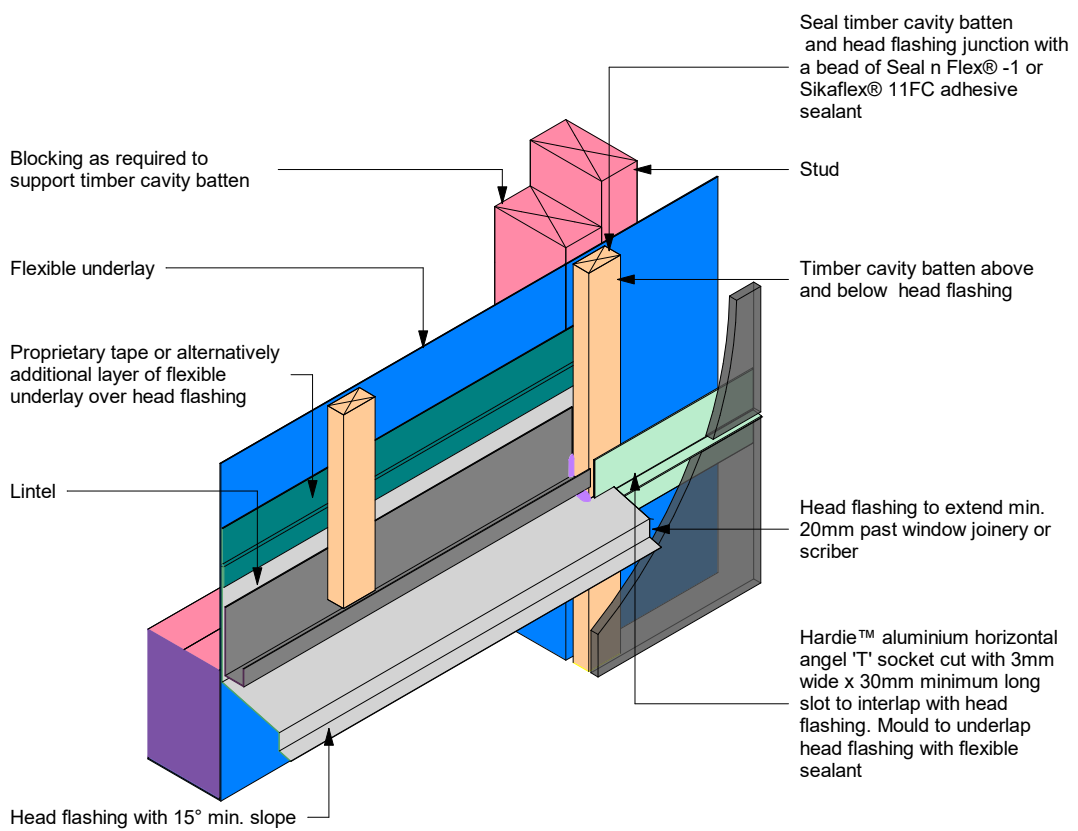


Figure 41: Horizontal flashing at window jamb

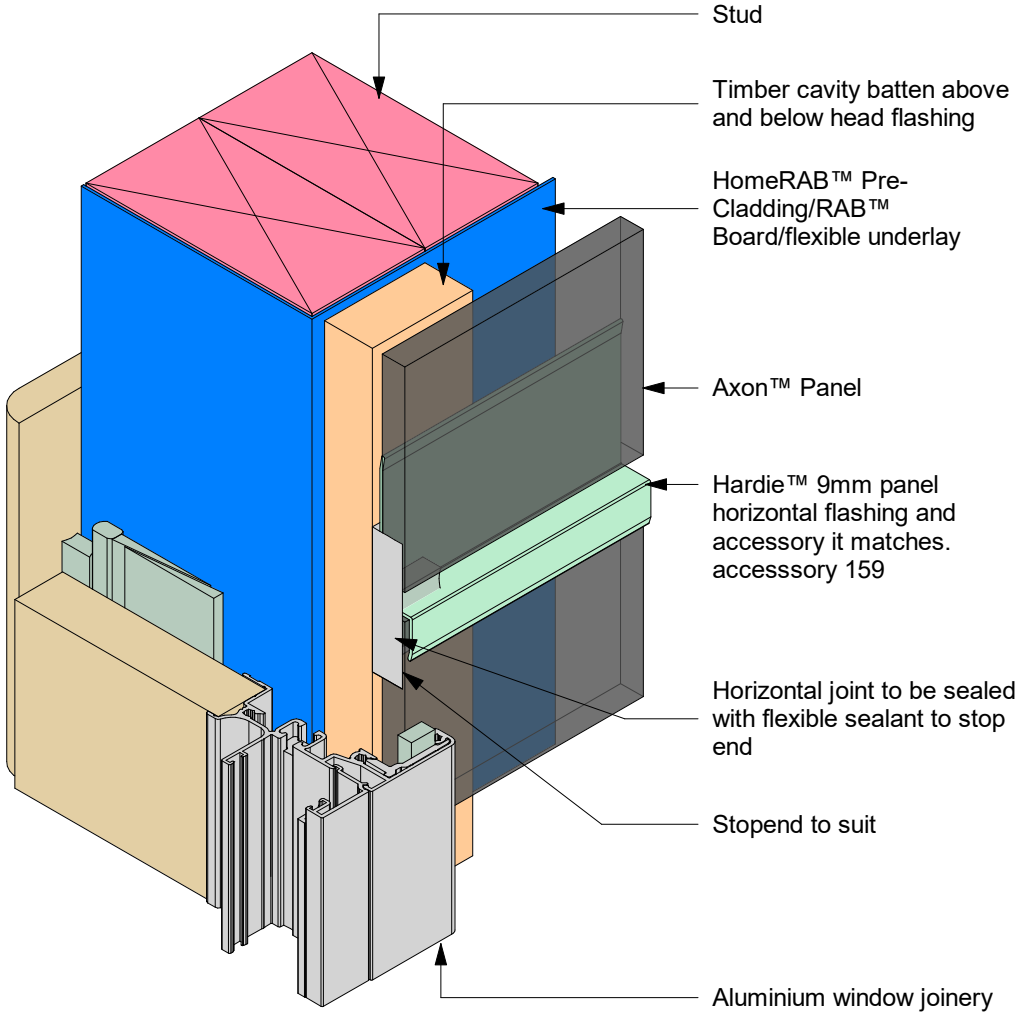


Figure 42: Angle 'T' socket butting window jamb


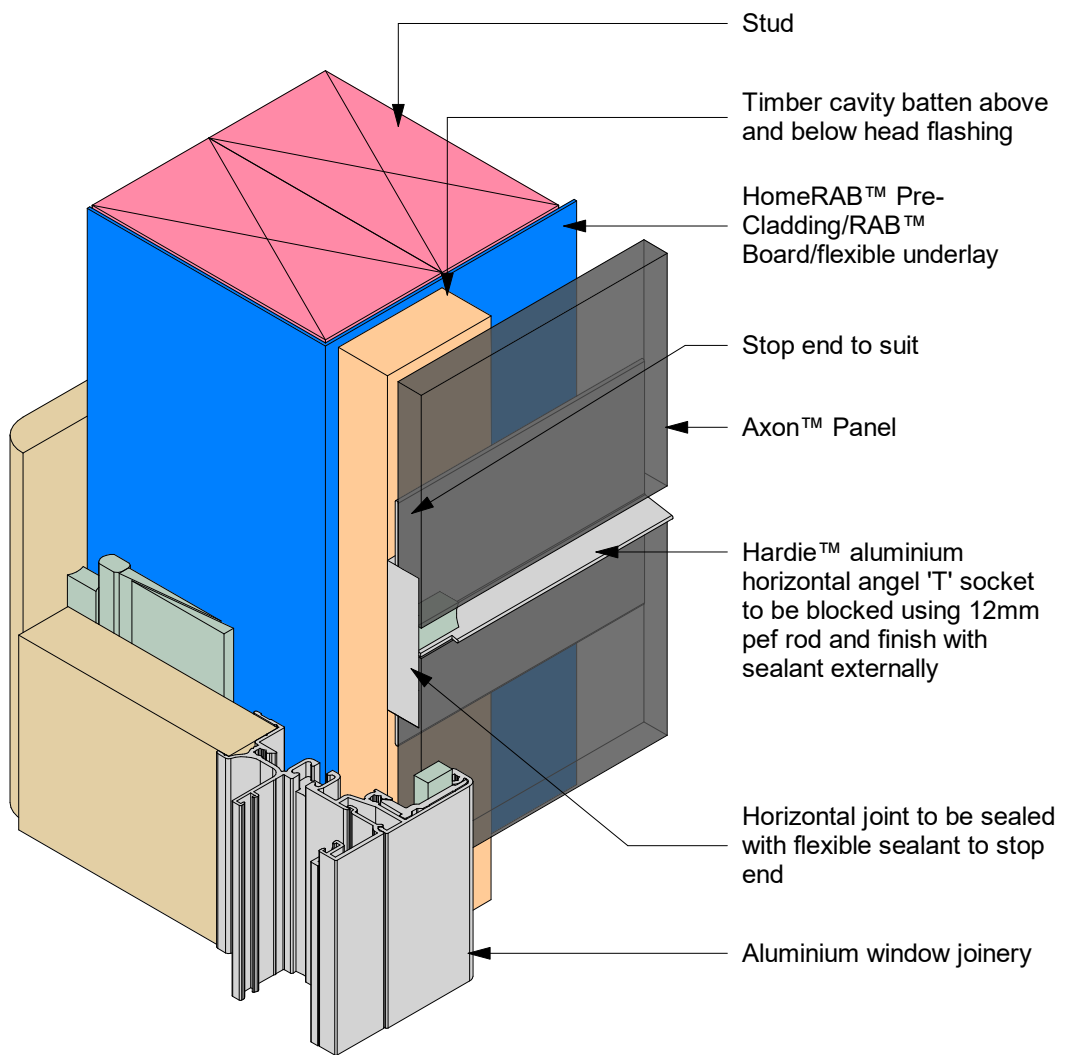


Figure 43: Drained flashing joint at floor joist

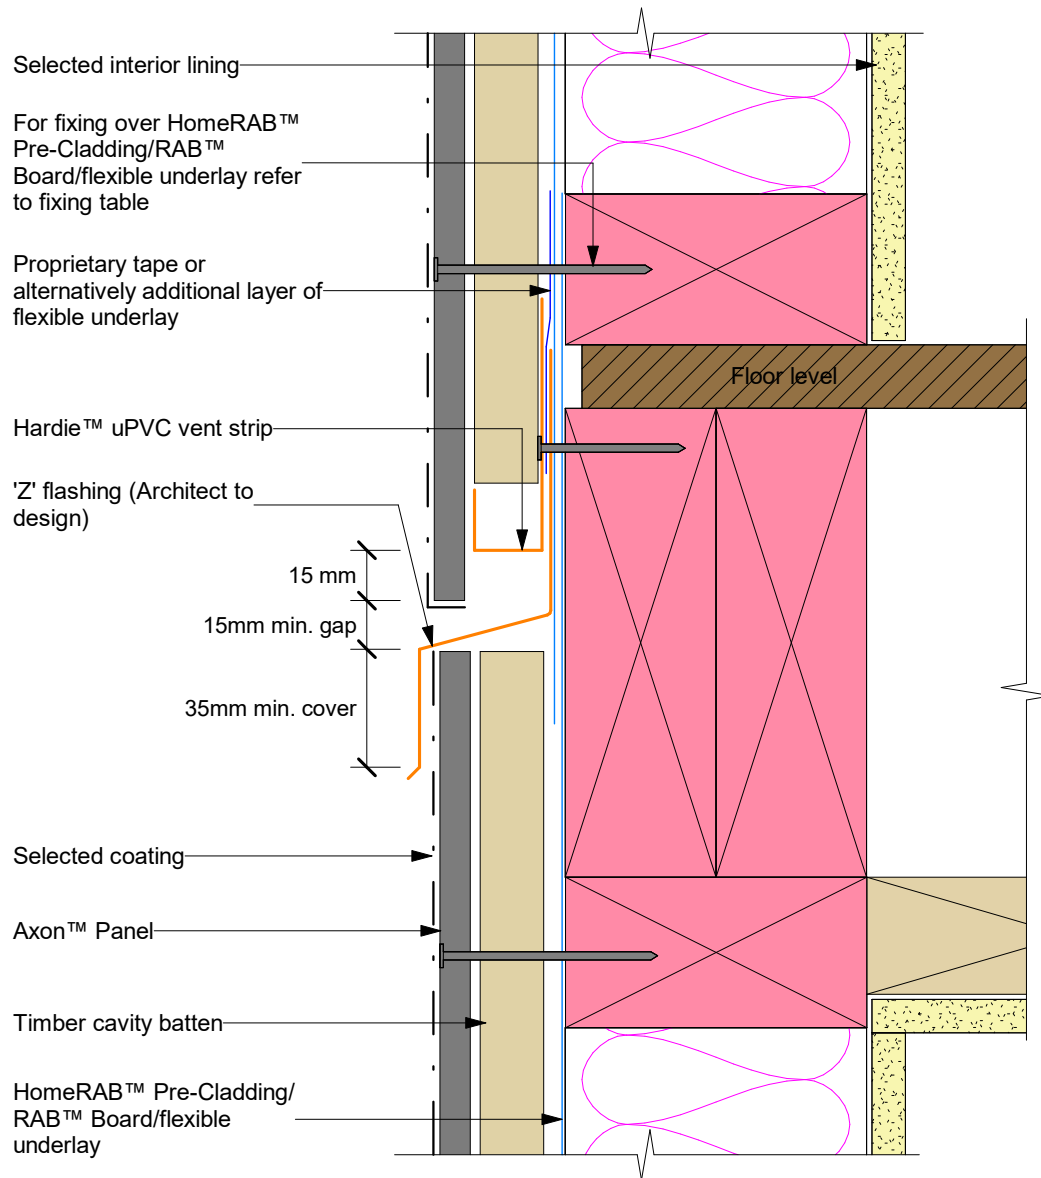

Note:

- * Check architect's plans for the type of flashing to be used.
- * Check fixing centres and edge distances.
- * Cut edges need to be primed with sealer.
- * When 50 year durability is required refer Table 20 E2/AS1.
- * The flashing to be placed in the centre of the floor joists. Do not fix Cavity Battens or panels into floor joists.

Figure 44: One piece apron flashing joint

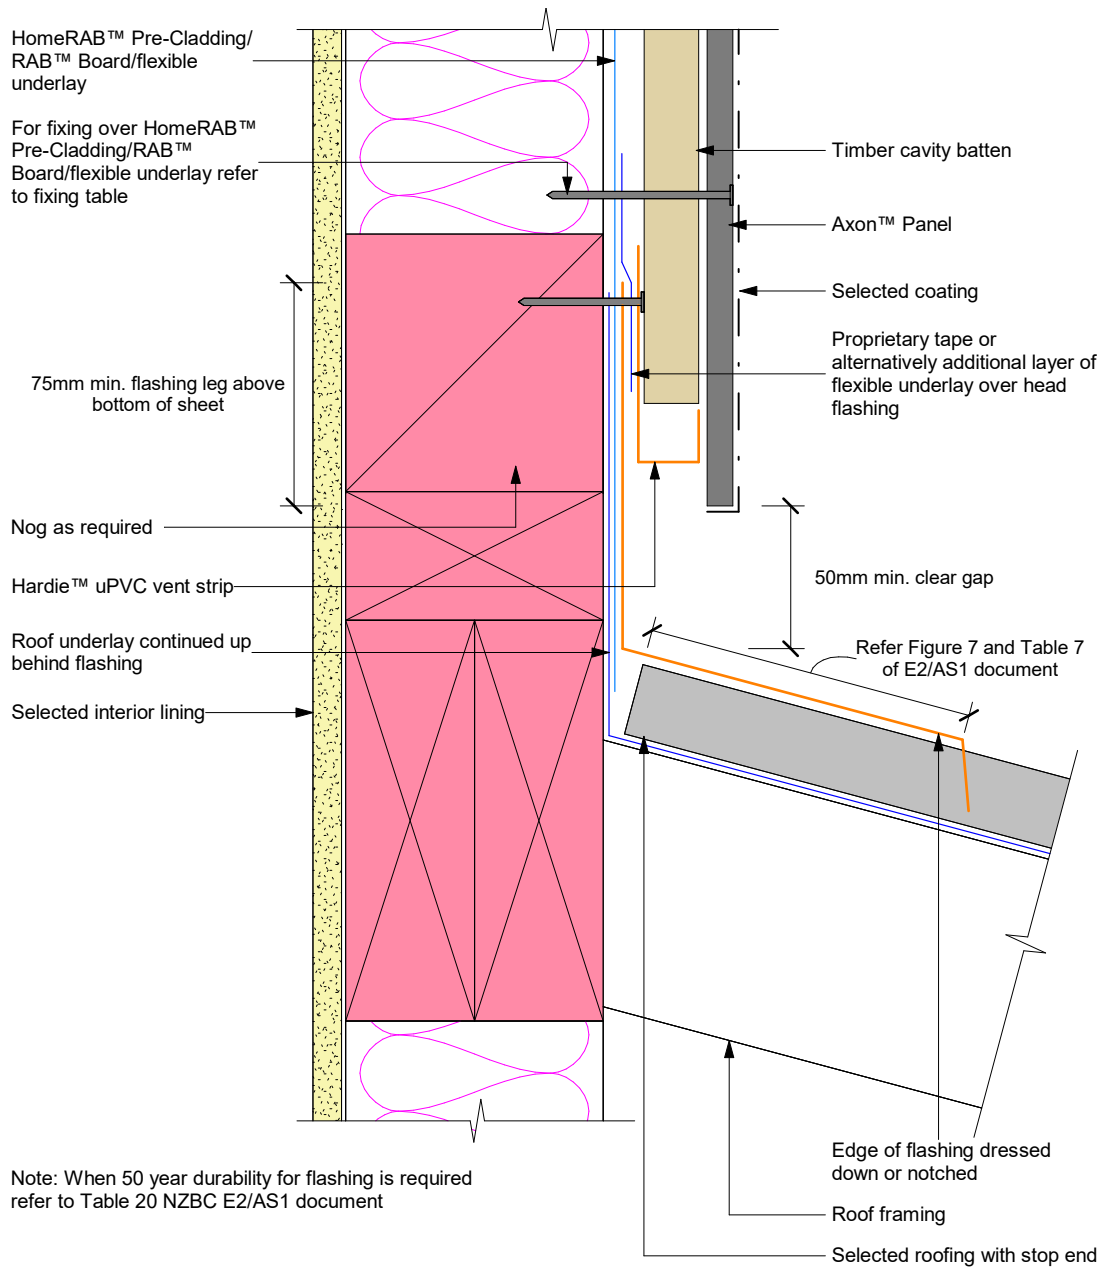


Figure 45: Enclosed deck balustrade to wall junction aluminium internal corner



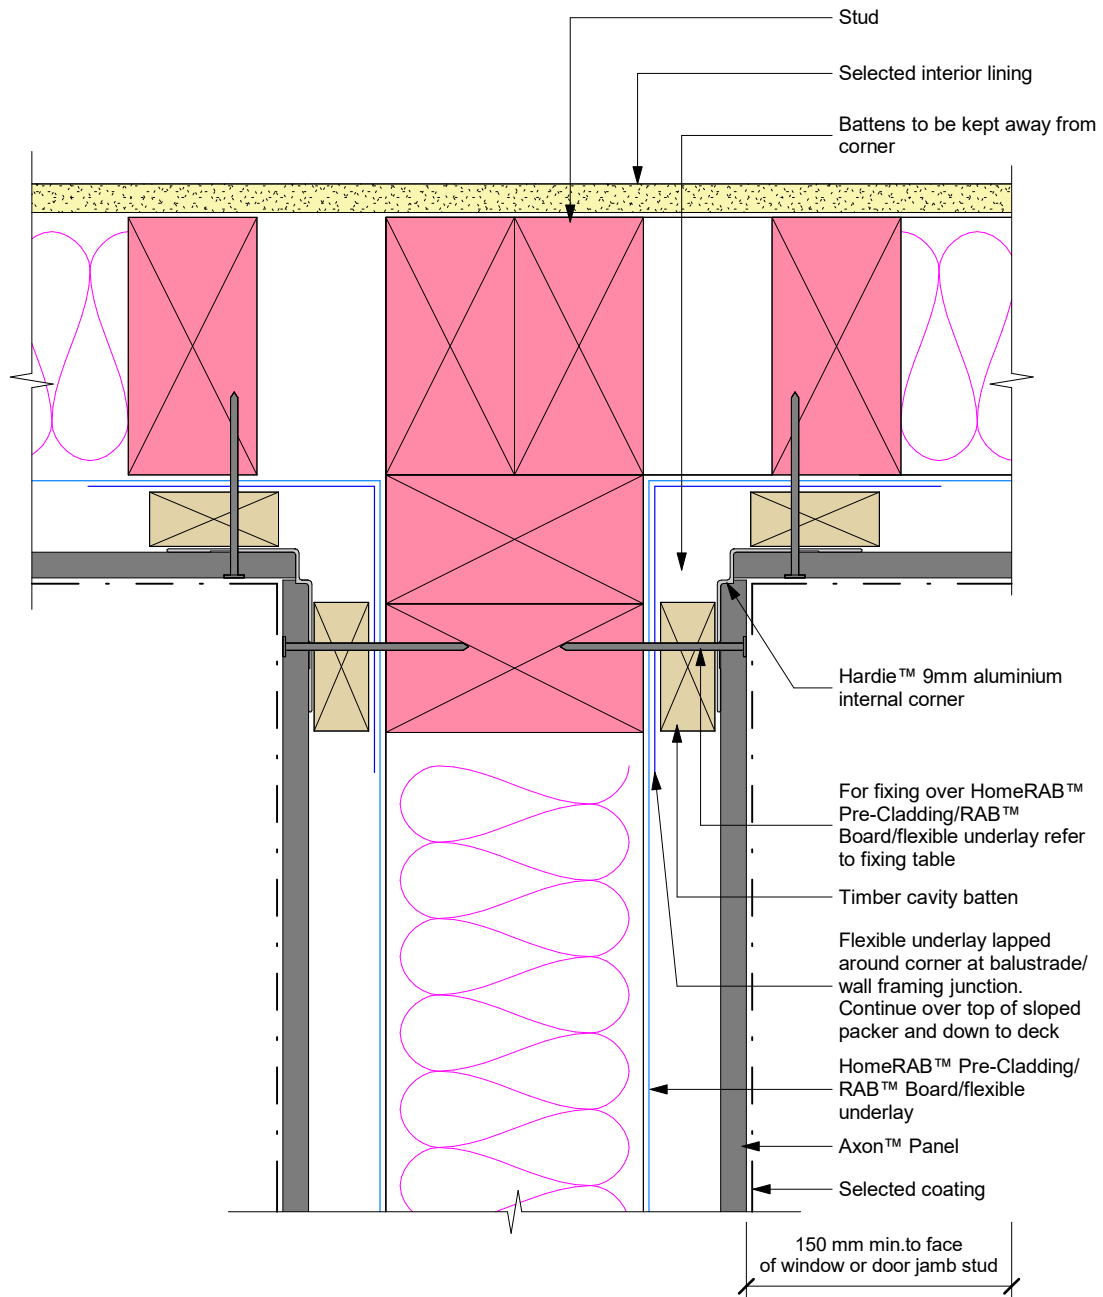


Figure 46: Enclosed deck balustrade to wall junction

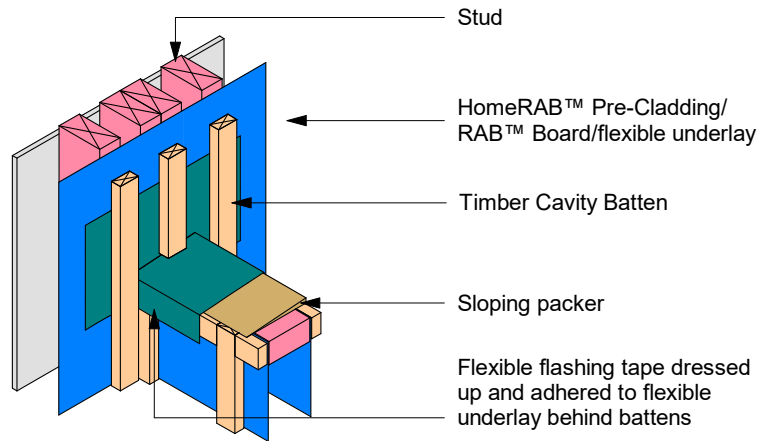

**Batten and Flashing Tape Application
Prior to Metal Flashing Fixing**

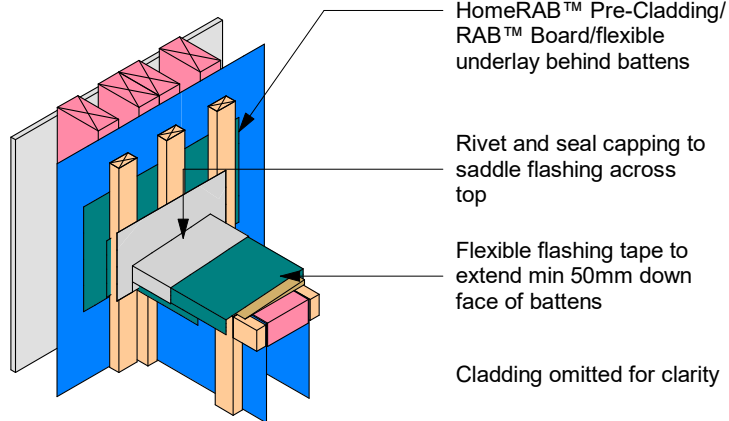

**Saddle Flashing Application Prior to
Cladding and Cap Flashing Fixing**

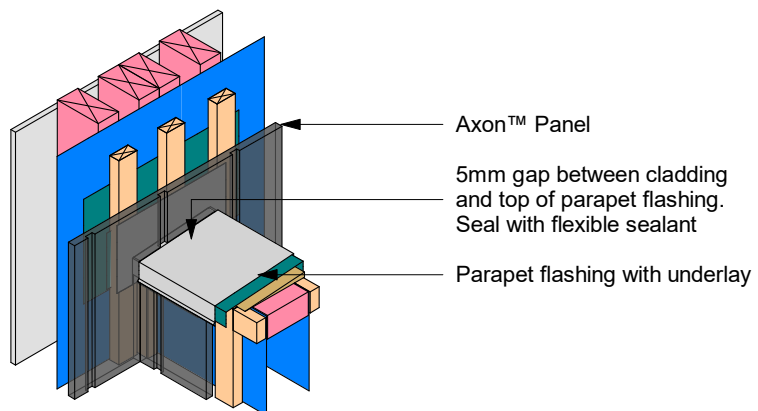


Figure 47: Parapet flashing

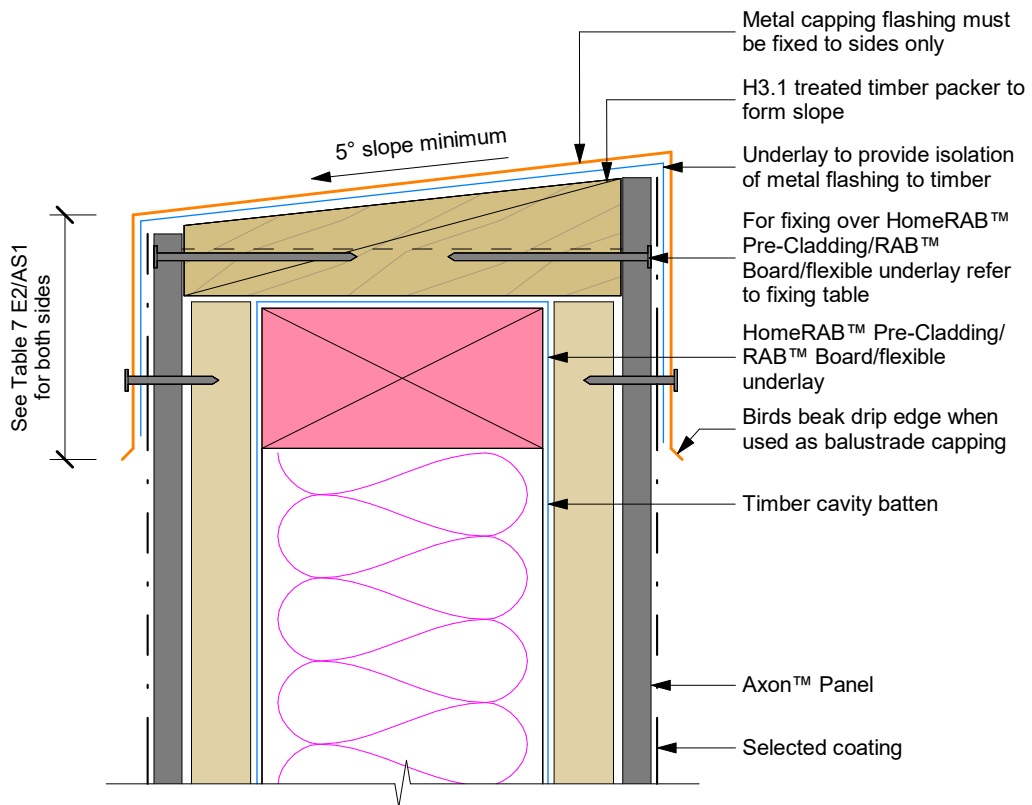


Figure 48: Garage jamb


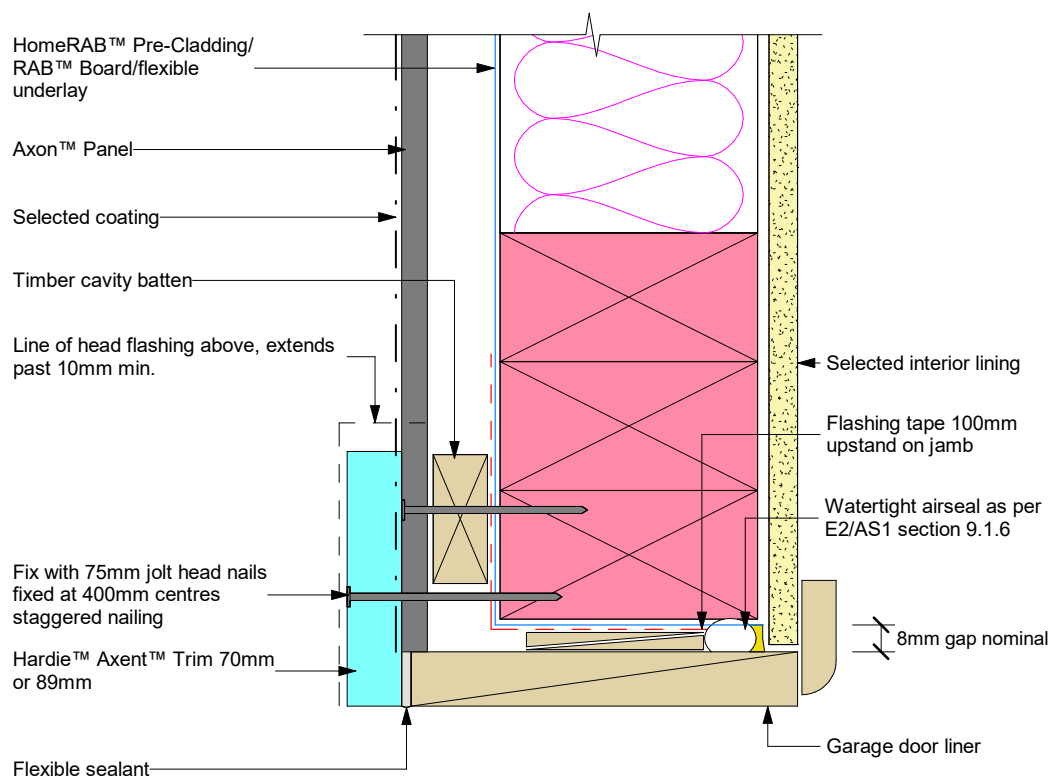


Figure 49: Garage head

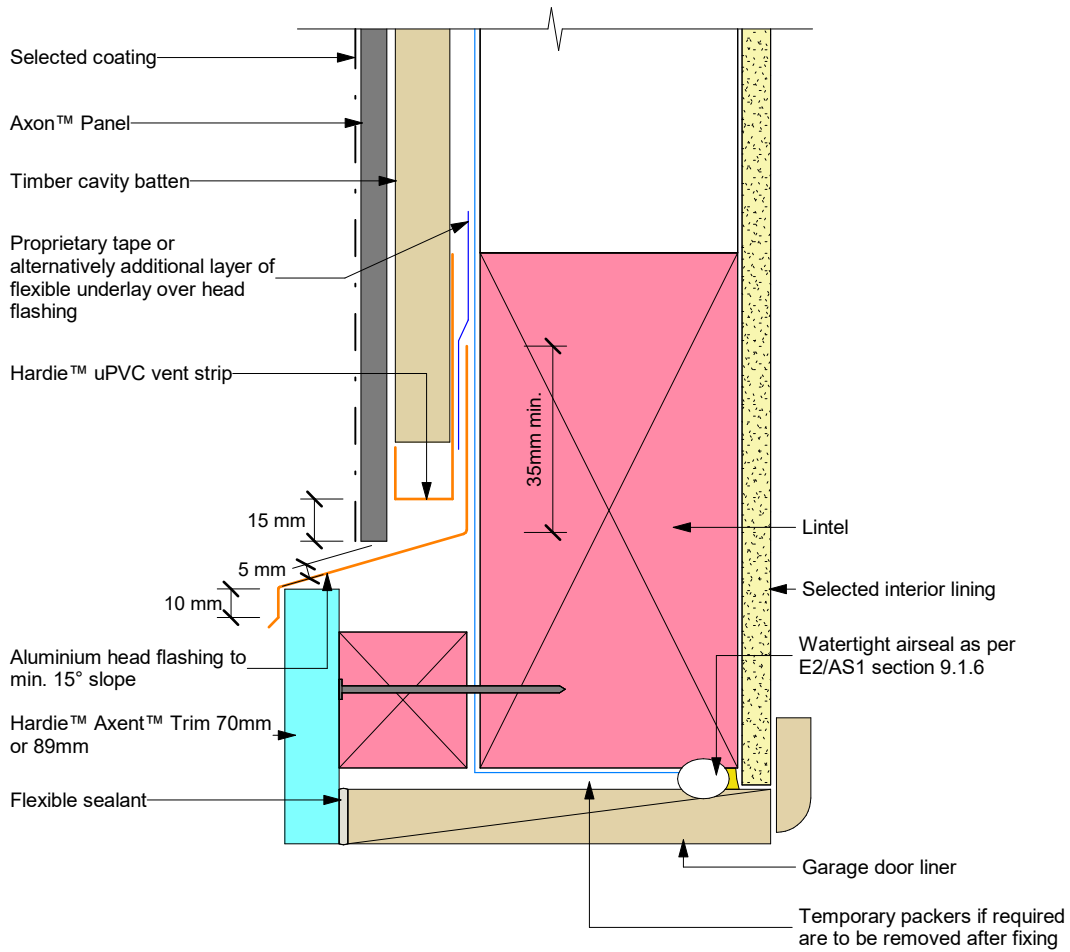

- Sealant must be applied between head flashing and Hardie™ Axent™ Trim in VH and EH wind zones
- Site cut edges to be primed

Figure 50: junction between panel and fascia board


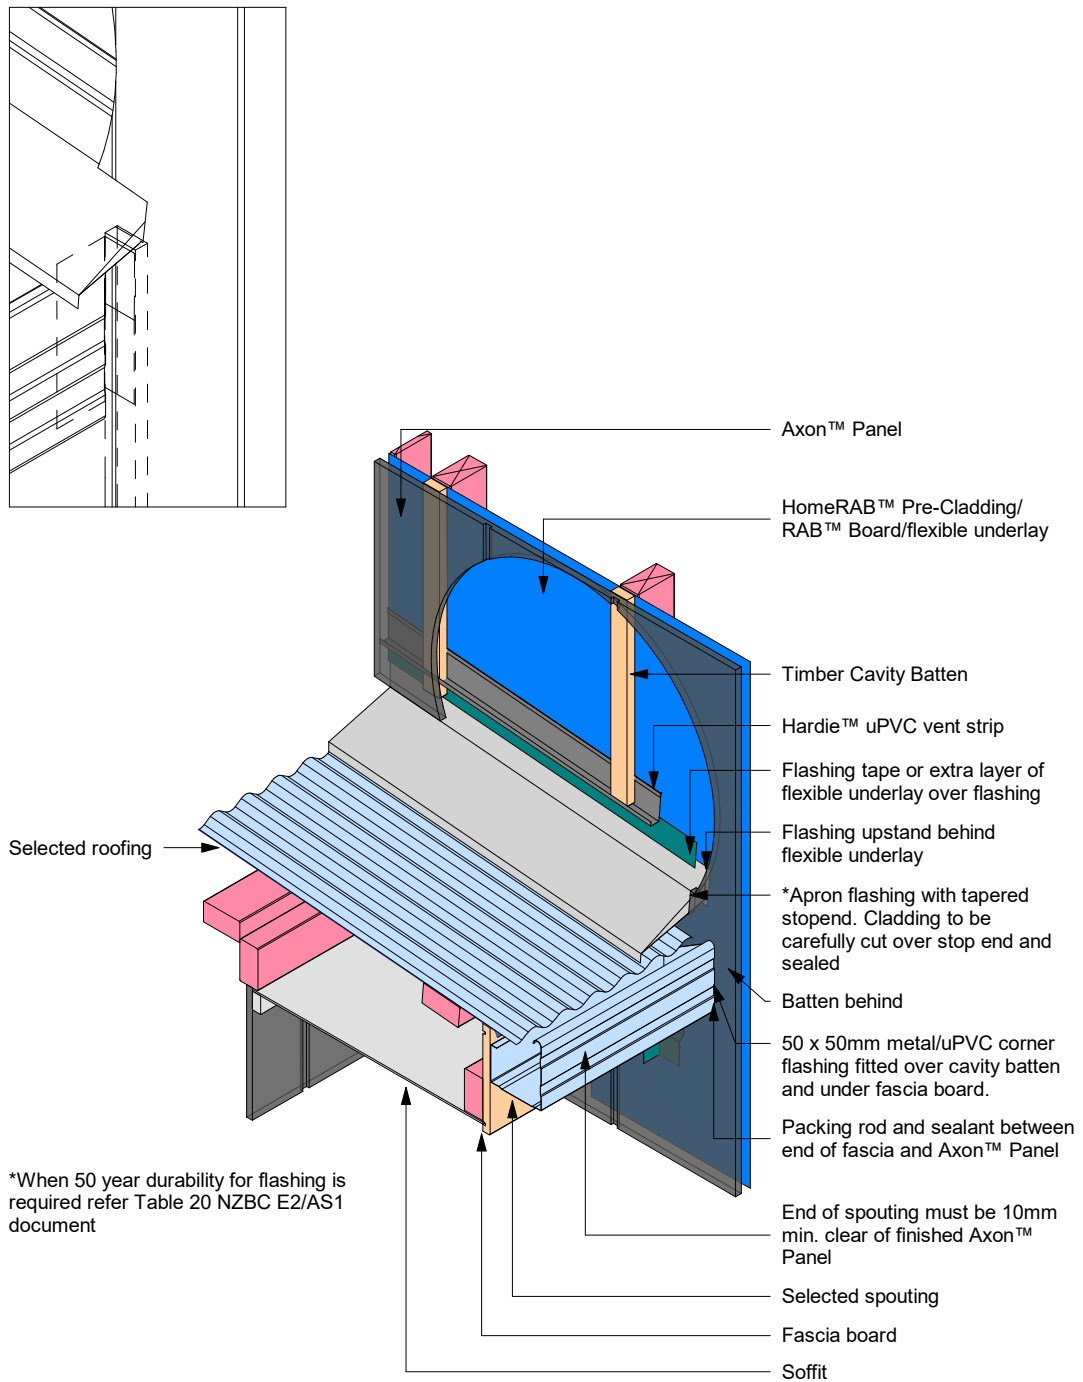


Figure 51: Enclosed roof to wall intersection

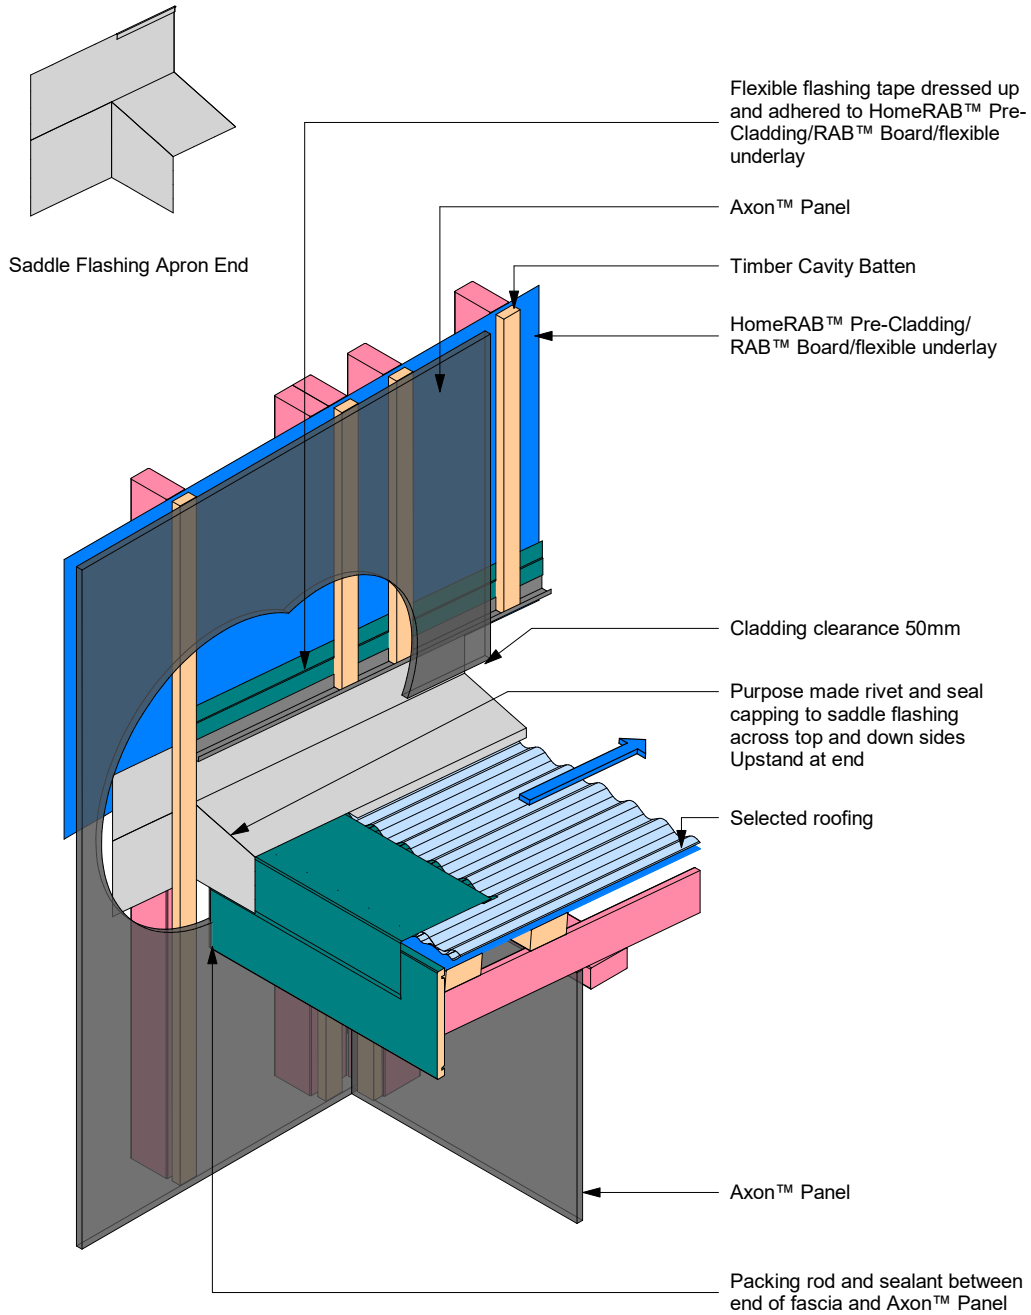

Product Warranty

James Hardie New Zealand Limited (“James Hardie”) warrants for a period of 15 years from the date of purchase that the Axon™ Panel (the “Product”), will be free from defects due to defective factory workmanship or materials and, subject to compliance with the conditions below, will be resistant to cracking, rotting, fire and damage from termite attacks to the extent set out in James Hardie’s relevant published literature current at the time of installation. James Hardie warrants for a period of 15 years from the date of purchase that the accessories supplied by James Hardie will be free from defects due to defective factory workmanship or materials.

Nothing in this document shall exclude or modify any legal rights a customer may have under the Consumer Guarantees Act or otherwise which cannot be excluded or modified at law.

CONDITIONS OF WARRANTY:

The warranty is strictly subject to the following conditions:

- a) James Hardie will not be liable for breach of warranty unless the claimant provides proof of purchase and makes a written claim either within 30 days after the defect would have become reasonably apparent or, if the defect was reasonably apparent prior to installation, then the claim must be made prior to installation.
- b) This warranty is not transferable.
- c) The Product must be installed and maintained strictly in accordance with the relevant James Hardie literature current at the time of installation and must be installed in conjunction with the components or products specified in the literature. Further, all other products, including coating and jointing systems, applied to or used in conjunction with the Product must be applied or installed and maintained strictly in accordance with the relevant manufacturer’s instructions and good trade practice.
- d) The project must be designed and constructed in strict compliance with all relevant provisions of the current New Zealand Building Code (“NZBC”), regulations and standards.
- e) The claimant’s sole remedy for breach of warranty is (at James Hardie’s option) that James Hardie will either supply replacement product, rectify the affected product or pay for the cost of the replacement or rectification of the affected product.
- f) James Hardie will not be liable for any losses or damages (whether direct or indirect) including property damage or personal injury, consequential loss, economic loss or loss of profits, arising in contract or negligence or howsoever arising. Without limiting the foregoing James Hardie will not be liable for any claims, damages or defects arising from or in any way attributable to poor workmanship, poor design or detailing, settlement or structural movement and/or movement of materials to which the Product is attached, incorrect design of the structure, acts of God including but not limited to earthquakes, cyclones, floods or other severe weather conditions or unusual climatic conditions, efflorescence or performance of paint/coatings applied to the Product, normal wear and tear, growth of mould, mildew, fungi, bacteria, or any organism on any Product surface or Product (whether on the exposed or unexposed surfaces).
- g) All warranties, conditions, liabilities and obligations other than those specified in this warranty are excluded to the fullest extent allowed by law.
- h) If meeting a claim under this warranty involves re-coating of Products, there may be slight colour differences between the original and replacement Products due to the effects of weathering and variations in materials over time.

Disclaimer: The recommendations in James Hardie’s literature are based on good building practice, but are not an exhaustive statement of all relevant information and are subject to conditions (c), (d), (f) and (g) above. James Hardie has tested/assessed the performance of the Axon™ Panel when installed in accordance with the relevant Axon™ Panel technical specification, in accordance with the standards and verification methods required by the NZBC and those test results demonstrate the product complies with the performance criteria established by the NZBC. However, as the successful performance of the relevant system depends on numerous factors outside the control of James Hardie (e.g. quality of workmanship and design) James Hardie shall not be liable for the recommendations made in its literature and the performance of the relevant system, including its suitability for any purpose or ability to satisfy the relevant provisions of the NZBC, regulations and standards, as it is the responsibility of the building designer to ensure that the details and recommendations provided in the relevant James Hardie installation manual are suitable for the intended project and that specific design is conducted where appropriate.

© 2023. James Hardie New Zealand Limited. TM and ® denotes a Trademark or Registered Mark owned by James Hardie Technology Limited.

