





Accredited for compliance with ISO/IEC 17025 -Testing

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration and inspection reports

OIL-WET INCLINING PLATFORM SLIP RESISTANCE TEST Safeguard R10

Prepared for: Armstrong Flooring

Jun Phang

29-39 Mills Road

BRAESIDE VIC 3195

Sample Description: Safeguard R10

No. of Specimens &

Size Supplied:

1 off, 500x1000 mm, (Sampling Conducted by Client)

Surface Structure: Structured

Specimen Preparation: Washed with water and pH neutral detergent, rinsed then dried.

Specimen Configuration: Unfixed

Test Direction: Test direction not applicable.

Joint Type & Width: N/A
Air Temperature: 23°C

Test Standard: AS 4586:2013 Slip resistance classification of new pedestrian surface

materials, Appendix D - Oil Wet Inclining Platform Test

Test Shoe: Leipzig V73-SP

Test Location: ATTAR 44-48 Rocco Drive, Scoresby, VIC, 3179

Test Date: 29 August 2024

Test Personnel: Louie Karkatzoulis and Marcus Bosworth

| Displacement Space | Not tested | |
|---|------------|--|
| (rounded to the nearest 0.5cm³/dm²): | Not tested | |
| Displacement Space Assessment Group | Not tested | |
| (Appendix E, AS 4586 - 2013): | Not tested | |
| Corrected mean overall acceptance angle (α _{ave}) | 12° | |
| (rounded down to the nearest degree): | 12 | |
| Classification: | R10 | |

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip resistance be checked.

Prepared By:

Louie Karkatzoulis

Compliance and Testing Technician

Reviewed By:

Marcus Braché

Senior Engineering Technician

Approved Signatory



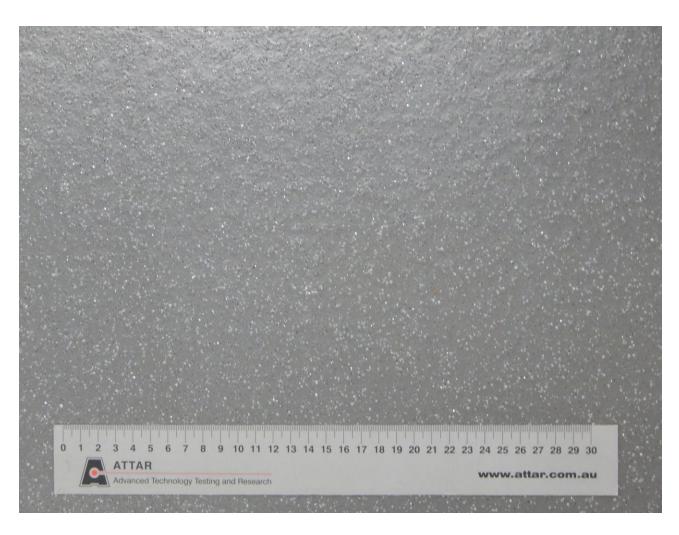


Figure 1: Safeguard R10



<u>CLASSIFICATION CRITERIA – AS 4586 - 2013</u> <u>Oil Wet Inclining Platform Test – Appendix D</u>

Compliance

TABLE 5: CLASSIFICATION OF PEDESTRIANSURFACE MATERIALS ACCORDING TO THE OIL-WET INCLINING PLATFORM TEST

| Classification | Angle, degrees |
|-------------------|----------------|
| No Classification | <6 |
| R9 | ≥6 <10 |
| R10 | ≥10 <19 |
| R11 | ≥19 <27 |
| R12 | ≥27 <35 |
| R13 | ≥35 |